


**DAVID DOUGLAS SCHOOL DISTRICT
LEAD TESTING RESULTS BY SCHOOL**

6/6/2016 3:59 PM

Classroom/Location	Analysis Report Date	Work Order #	1st Draw		1 Min Draw		Action Taken
			Test #1 mg/L	Test #2 mg/L	Test #1 mg/L	Test #2 mg/L	
ALICE OTT MIDDLE SCHOOL							
Kitchen 1	10/28/2013	3297017	0.0040	nd			none
Kitchen 2	10/28/2013	3297017	0.0020	nd			none
Gym	10/28/2013	3297017	nd		nd		none
GLR	10/28/2013	3297017	nd		nd		none
BLR	10/28/2013	3297017	nd		nd		none
26	10/28/2013	3297017	nd		nd		none
Lobby	10/28/2013	3297017	nd		nd		none
Hall 2	10/28/2013	3297017	nd		nd		none
Hall 9	10/28/2013	3297017	0.0320		0.0100		Turned off/Replaced bubbler 2/11/14 & retest
Hall 10	2/20/2014	4044020	0.0170	nd			Turned off
Hall 15	10/28/2013	3297017	0.0060		0.0110		none
Hall 29	10/28/2013	3297017	nd		nd		none
25	10/28/2013	3297017	0.0020	nd			none
Cafeteria	10/28/2013	3297017	nd		nd		none
11	10/28/2013	3297017	0.0060	nd			none
9	10/28/2013	3297017	0.0360		0.0110		Turned off
Retesting:							
RTAO9	11/11/2013	3304008	0.0210		0.0050		Remains off
RTA Hall 9	11/11/2013	3304008	0.0280		0.0030		Remains off
Hall 9	2/20/2014	4044020	0.0070	nd			Turned on after bubbler replaced
9	2/20/2014	4044020	0.0210		0.0230		Remains off
Hall 9	5/12/2016	6120002	0.0050	n/a			Test ok still after replacement, still on

ND - NONE DETECTED

ITEMS IN RED ARE OVER THE 20 PPB EPA RECOMMENDATION FOR REPLACEMENT

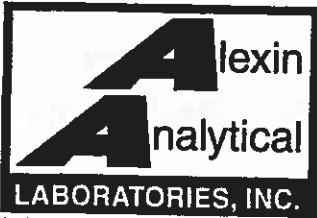

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 10/28/2013
Received: 10/24/2013
Sampled By: Faye Bayer
Work Order: 3297017

C
L
I
E
N
T
David Douglas School District
Attn: David Callaway
2900 SE 122nd
Portland OR, 97236
Phone: (503) 252-2900

Project: -
Project #: N/A
PWSID #: -
PO #: 140989


Sampling Location: Alice Ott
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 10/22/13 5:24		Sample Composition:					
3297017-01	AOKITCHEN1A								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
[†] Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	10/25/13 16:07	

Lab Number	Sample Name	Sampled: 10/22/13 5:26		Sample Composition:					
3297017-02	AOKITCHEN1B								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07	

Lab Number	Sample Name	Sampled: 10/22/13 5:27		Sample Composition:					
3297017-03	AOKITCHEN2A								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
[†] Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	10/25/13 16:07	

Lab Number	Sample Name	Sampled: 10/22/13 5:28		Sample Composition:					
3297017-04	AOKITCHEN2B								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07	

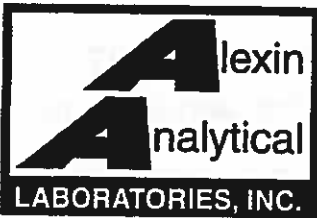

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 10/28/2013
Received: 10/24/2013
Sampled By: Faye Bayer
Work Order: 3297017

**C
L
I
E
N
T**
David Douglas School District
Attn: David Callaway
2900 SE 122nd
Portland OR, 97236
Phone: (503) 252-2900

Project: -
Project # : N/A
PWSID # : -
PO # : 140989

Sampling Location: Alice Ott
Sample Matrix: Drinking Water

Lab Number **Sample Name** **Sampled:** 10/18/13 7:41 **Sample Composition:**
3297017-05 **AOGYMA**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number **Sample Name** **Sampled:** 10/18/13 7:42 **Sample Composition:**
3297017-06 **AOGYMB**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number **Sample Name** **Sampled:** 10/18/13 7:44 **Sample Composition:**
3297017-07 **AOGLRA**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number **Sample Name** **Sampled:** 10/18/13 7:46 **Sample Composition:**
3297017-08 **AOGLRB**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

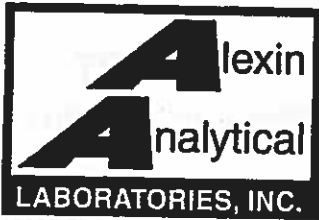

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 10/28/2013
Received: 10/24/2013
Sampled By: Faye Bayer
Work Order: 3297017

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 140989


Sampling Location: Alice Ott
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 10/18/13 7:49		Sample Composition:				
3297017-09	AOBLRA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/18/13 7:51		Sample Composition:				
3297017-10	AOBLRB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/18/13 7:34		Sample Composition:				
3297017-11	AO26A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/18/13 7:36		Sample Composition:				
3297017-12	AO26B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

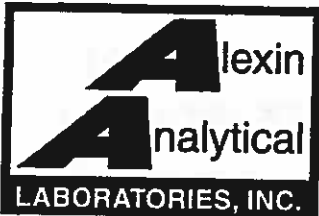

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 10/28/2013
Received: 10/24/2013
Sampled By: Faye Bayer
Work Order: 3297017

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 140989

Sampling Location: Alice Ott
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 10/22/13 5:43		Sample Composition:				
3297017-13	AOLOBBYA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/22/13 5:45		Sample Composition:				
3297017-14	AOLOBBYB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/22/13 5:49		Sample Composition:				
3297017-15	AOHALL2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/22/13 5:52		Sample Composition:				
3297017-16	AOHALL2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 10/28/2013
Received: 10/24/2013
Sampled By: Faye Bayer
Work Order: 3297017

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989


Sampling Location: Alice Ott
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 10/18/13 7:12		Sample Composition:				
3297017-17	AOHALL9A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.032	0.002	0.015	-	10/25/13 16:07 MCLE

Lab Number	Sample Name	Sampled: 10/18/13 7:14		Sample Composition:				
3297017-18	AOHALL9B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/18/13 7:20		Sample Composition:				
3297017-19	AOHALL15A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/18/13 7:22		Sample Composition:				
3297017-20	AOHALL15B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.011	0.002	0.015	-	10/25/13 16:07

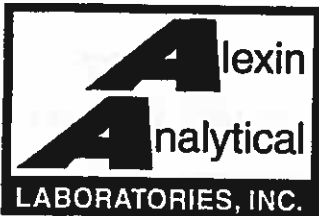

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 10/28/2013
Received: 10/24/2013
Sampled By: Faye Bayer
Work Order: 3297017

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 140989


Sampling Location: Alice Ott
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 10/22/13 6:15		Sample Composition:				
3297017-21	AOHALL29A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/22/13 6:17		Sample Composition:				
3297017-22	AOHALL29B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/18/13 7:27		Sample Composition:				
3297017-23	AO25A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/18/13 7:29		Sample Composition:				
3297017-24	AO25B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

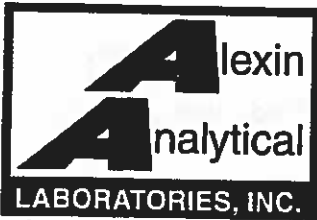

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 839-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 10/28/2013
Received: 10/24/2013
Sampled By: Faye Bayer
Work Order: 3297017

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 140989


Sampling Location: Alice Ott
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 10/22/13 5:32		Sample Composition:				
3297017-25	AOCAFE1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/22/13 5:34		Sample Composition:				
3297017-26	AOCAFE1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/22/13 6:04		Sample Composition:				
3297017-27	AO11A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	10/25/13 16:07

Lab Number	Sample Name	Sampled: 10/22/13 6:06		Sample Composition:				
3297017-28	AO11B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/25/13 16:07

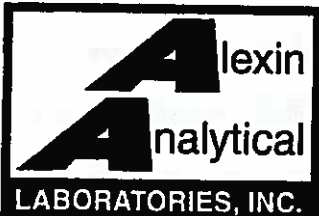

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 10/28/2013
Received: 10/24/2013
Sampled By: Faye Bayer
Work Order: 3297017

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 140989

Sampling Location: Alice Ott
Sample Matrix: Drinking Water

Lab Number 3297017-29 **Sample Name** A09A **Sampled:** 10/22/13 5:58 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.036	0.002	0.015	-	10/25/13 16:07 MCLE


Lab Number 3297017-30 **Sample Name** A09B **Sampled:** 10/22/13 6:00 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.011	0.002	0.015	-	10/25/13 16:07


ND = None detected **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit

MCLE This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

Approved by: 
Scott Dickman
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.

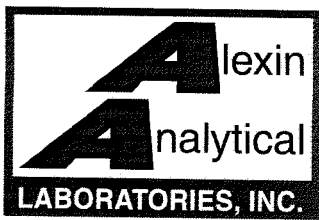

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/20/2014
Received: 02/13/2014
Sampled By: Faye Bayer
Work Order: 4044020

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141935


Sampling Location: Alice OTT
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled:	Sample Composition:					
4044020-01	R2AO Hall9A	2/13/14 8:03						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	02/19/14 16:42

Lab Number	Sample Name	Sampled:	Sample Composition:					
4044020-02	R2AO Hall9B	2/13/14 8:04						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/19/14 16:42

Lab Number	Sample Name	Sampled:	Sample Composition:					
4044020-03	R2AO Hall10A	2/13/14 8:01						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.017	0.002	0.015	-	02/19/14 16:42 MCLE

Lab Number	Sample Name	Sampled:	Sample Composition:					
4044020-04	R2AO Hall10B	2/13/14 8:03						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/19/14 16:42

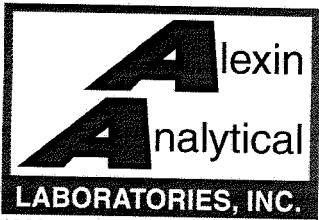

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/20/2014
Received: 02/13/2014
Sampled By: Faye Bayer
Work Order: 4044020

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141935


Sampling Location: Alice OTT
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 2/13/14 7:57		Sample Composition:				
4044020-05	R2AO 9A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.021	0.002	0.015	-	02/19/14 16:42 MCLE

Lab Number	Sample Name	Sampled: 2/13/14 7:58		Sample Composition:				
4044020-06	R2AO 9B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.023	0.002	0.015	-	02/19/14 16:42 MCLE

ND = None detected **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit
MCLE This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

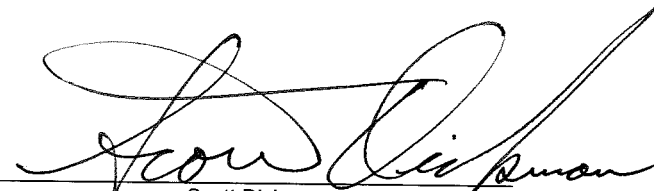Approved by: 
Scott Dickman
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

RECEIVED

MAY 25 2016

ACCOUNTS PAYABLE

Reported: 05/12/2016
Received: 04/29/2016
Sampled By: Troy Thompson
Work Order: 6120002

**C
L
I
E
N
T**
David Douglas School District
Attn: Troy Thompson
11300 NE Halsey St
Portland OR, 97220
Phone: (503) 252-2900

Project:
Project # : N/A
PWSID # :

Sampling Location: Varies
Sample Matrix: Water

Lab Number

	Code	Method	Units	Result	MRL	EPA MCL	Analysis Date/ Time
6120002-01 Sample Name: GP Cafe C Sampled: 4/17/16 6:17							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	05/09/16 17:17
6120002-02 Sample Name: GP Cafe D Sampled: 4/17/16 6:17							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	05/09/16 17:17
6120002-03 Sample Name: GP GC Sampled: 4/17/16 6:15							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	05/09/16 17:17
6120002-04 Sample Name: GP GD Sampled: 4/17/16 6:15							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-05 Sample Name: AO hall 9C Sampled: 4/17/16 6:45							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	05/09/16 17:17
6120002-06 Sample Name: AO hall 9D Sampled: 4/17/16 6:45							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-07 Sample Name: EB 3C Sampled: 4/17/16 6:30							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

RECEIVED

MAY 25 2016

ACCOUNTS PAYABLE

Reported: 05/12/2016
Received: 04/29/2016
Sampled By: Troy Thompson
Work Order: 6120002

C
L
I
E
N
T

David Douglas School District
Attn: Troy Thompson
11300 NE Halsey St
Portland OR, 97220
Phone: (503) 252-2900

Project:
Project # : N/A
PWSID # :

Sampling Location: Varies
Sample Matrix: Water

Lab Number

	Code	Method	Units	Result	MRL	EPA MCL	Analysis Date/ Time
6120002-08	Sample Name: EB 3D Sampled: 4/17/16 6:30						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-09	Sample Name: GH 20C Sampled: 4/17/16 6:45						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.095	0.008	0.015	05/09/16 17:17 MCLE
6120002-10	Sample Name: GH 20D Sampled: 4/17/16 6:45						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	05/09/16 17:17
6120002-11	Sample Name: GH CL #1A Sampled: 4/17/16 6:50						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	05/09/16 17:17
6120002-12	Sample Name: GH CL #1B Sampled: 4/17/16 6:50						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-13	Sample Name: GH hall 1D Sampled: 4/17/16 6:46						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	05/11/16 14:46
6120002-14	Sample Name: GH hall 1C Sampled: 4/17/16 6:45						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.023	0.002	0.015	05/11/16 14:46 MCLE



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

RECEIVED

MAY 25

ACCOUNTS PAYABLE

Reported: 05/12/2016
Received: 04/29/2016
Sampled By: Troy Thompson
Work Order: 6120002

C
L
I
E
N
T

David Douglas School District
Attn: Troy Thompson
11300 NE Halsey St
Portland OR, 97220
Phone: (503) 252-2900

Project:
Project # : N/A
PWSID # :

Sampling Location: Varies
Sample Matrix: Water

Lab Number

MCLE This analyte exceeds the MCL limit.


ND = None detected at the MRL **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit

†All procedures for this analysis are accredited in accordance with NELAP standards.

Approved by: _____

Adriana Gonzalez-Gray
Laboratory Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 11/11/2013
Received: 10/31/2013
Sampled By:
Work Order: 3304008

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989


Sampling Location: Alice Ott
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 10/30/13 7:46		Sample Composition:				
3304008-01	RTA09A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.021	0.002	0.015	-	11/06/13 13:53 MCL

Lab Number	Sample Name	Sampled: 10/30/13 7:47		Sample Composition:				
3304008-02	RTA09B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	11/06/13 13:53

Lab Number	Sample Name	Sampled: 10/30/13 7:48		Sample Composition:				
3304008-03	RTAOHALL9A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.028	0.002	0.015	-	11/06/13 13:53 MCL

Lab Number	Sample Name	Sampled: 10/30/13 7:50		Sample Composition:				
3304008-04	RTAOHALL9B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	11/06/13 13:53

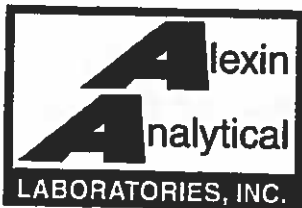

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-8311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/11/2013

Received: 10/31/2013

Sampled By:

Work Order: 3304008

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N
T Phone: (503) 252-2900

Project: -
Project # : N/A
PWSID # : -
PO # : 140989

Sampling Location: Alice Ott
Sample Matrix: Drinking Water

ND = None detected **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit
MCLE This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

Approved by: _____

Scott Dickman
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.