


**DAVID DOUGLAS SCHOOL DISTRICT
LEAD TESTING RESULTS BY SCHOOL**

6/6/2016 3:59 PM

CHERRY PARK ELEMENTARY SCHOOL

Classroom/Location	Analysis Report Date	Work Order #	1st Draw	1 Min Draw	Action Taken
			Test #1 mg/L	Test #2 mg/L	
1	2/10/2014	4031009	0.0050	0.0050	none
2	2/10/2014	4031009	0.0110	0.0080	none
3	2/10/2014	4031009	0.0140	0.0100	none
4	2/10/2014	4031009	0.0140	0.0100	none
5	2/10/2014	4031009	0.0300	0.0280	Turned off
6	2/10/2014	4031009	0.0260	0.0270	Turned off
7	2/10/2014	4031009	0.0060	0.0080	none
8	2/10/2014	4031009	0.0110	nd	none
9	2/10/2014	4031009	0.0110	0.0040	none
10	2/10/2014	4031009	0.0250	0.0180	Turned off
11	2/10/2014	4031009	0.0180	0.0200	Turned off
12	2/10/2014	4031009	0.0200	0.0230	Turned off
13	2/10/2014	4031009	0.0150	0.0050	none
14	2/10/2014	4031009	0.0120	0.0120	none
15	2/10/2014	4031009	0.0310	0.0140	Turned off
16	2/10/2014	4031009	0.0210	0.0240	Turned off
17					
18					
19	2/10/2014	4031009	0.0160	0.0050	Turned off
20	2/10/2014	4031009	0.0140	nd	none
21	2/10/2014	4031009	0.0110	nd	none
22	2/10/2014	4031009	0.0090	0.0020	none
23	2/10/2014	4031009	0.0090	0.0050	none
24	2/10/2014	4031009	0.0240	0.0260	Turned off
Gym	2/10/2014	4031009	0.0040	0.0050	none
Cafeteria	2/10/2014	4031009	nd	nd	none
Hall RM4	2/10/2014	4031009	0.0120	0.0280	Turned off
Hall RM 27	2/10/2014	4031009	nd	nd	none
Hall RM 10	2/10/2014	4031009	0.0220	0.0240	Turned off
Hall RM 22	2/10/2014	4031009	0.0070	nd	none
Hall Gym	2/10/2014	4031009	nd	nd	none
Kitchen 1	2/10/2014	4031009	nd	nd	none
Kitchen 2	2/10/2014	4031009	0.0730	0.0040	Turned off
Cherry Park Elementary had water delivered starting in March 2014. School was repiped summer of 2015.					
Retesting completed 2015 after repiping:					
Library	9/15/2015	Devco	0.0115	0.0029	Meets standards
6	9/15/2015	Devco	0.0014	0.0011	Meets standards
24	9/15/2015	Devco	0.0014	0.0010	Meets standards
Kitchen 2	9/15/2015	Devco	0.0022	0.0008	Meets standards
12	9/15/2015	Devco	0.0010	0.0006	Meets standards

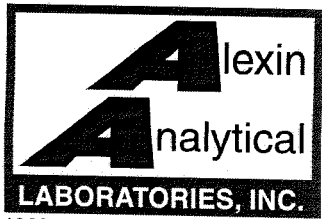

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/16/14 6:48		Sample Composition:				
4031009-01	CP1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 6:49		Sample Composition:				
4031009-02	CP1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 6:52		Sample Composition:				
4031009-03	CP2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.011	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 6:55		Sample Composition:				
4031009-04	CP2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	02/03/14 16:13

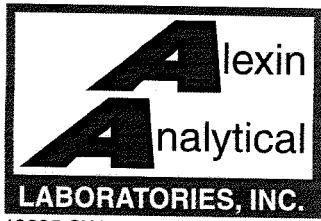

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/16/14 6:57		Sample Composition:				
4031009-05	CP3A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.014	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 6:58		Sample Composition:				
4031009-06	CP3B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 6:59		Sample Composition:				
4031009-07	CP4A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.014	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 7:02		Sample Composition:				
4031009-08	CP4B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	-	02/03/14 16:13

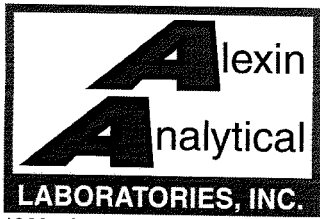

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N
T Phone: (503) 252-2900

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/16/14 7:06		Sample Composition:				
4031009-09	CP5A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.030	0.002	0.015	-	02/03/14 16:13 MCLE

Lab Number	Sample Name	Sampled: 1/16/14 7:07		Sample Composition:				
4031009-10	CP5B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.028	0.002	0.015	-	02/03/14 16:13 MCLE

Lab Number	Sample Name	Sampled: 1/16/14 7:10		Sample Composition:				
4031009-11	CP6A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.026	0.002	0.015	-	02/03/14 16:13 MCLE

Lab Number	Sample Name	Sampled: 1/16/14 7:11		Sample Composition:				
4031009-12	CP6B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.027	0.002	0.015	-	02/03/14 16:13 MCLE

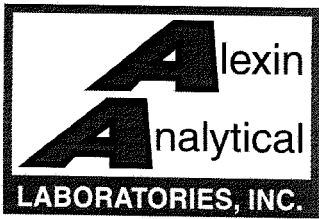

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

**C
L
I
E
N
T**
David Douglas School District
Attn: David Callaway
2900 SE 122nd
Portland OR, 97236
Phone: (503) 252-2900

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/16/14 7:14		Sample Composition:				
4031009-13	CP7A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 7:16		Sample Composition:				
4031009-14	CP7B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 7:17		Sample Composition:				
4031009-15	CP8A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.011	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 7:18		Sample Composition:				
4031009-16	CP8B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/03/14 16:13

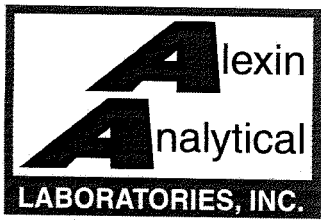

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/16/14 7:20		Sample Composition:				
4031009-17	CP9A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.011	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 7:21		Sample Composition:				
4031009-18	CP9B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 7:23		Sample Composition:				
4031009-19	CP10A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.025	0.002	0.015	-	02/03/14 16:13 MCLE

Lab Number	Sample Name	Sampled: 1/16/14 7:25		Sample Composition:				
4031009-20	CP10B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.018	0.002	0.015	-	02/03/14 16:13 MCLE

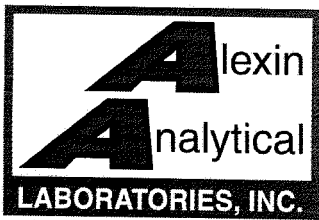

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/16/14 7:27		Sample Composition:				
4031009-21	CP11A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.018	0.002	0.015	-	02/03/14 16:13 MCLE

Lab Number	Sample Name	Sampled: 1/16/14 7:29		Sample Composition:				
4031009-22	CP11B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.020	0.002	0.015	-	02/03/14 16:13 MCLE

Lab Number	Sample Name	Sampled: 1/16/14 7:30		Sample Composition:				
4031009-23	CP12A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.020	0.002	0.015	-	02/03/14 16:13 MCLE

Lab Number	Sample Name	Sampled: 1/16/14 7:32		Sample Composition:				
4031009-24	CP12B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.023	0.002	0.015	-	02/03/14 16:13 MCLE

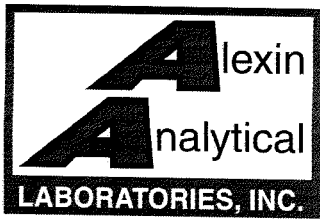

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/16/14 7:35		Sample Composition:				
4031009-25	CP13A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.015	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 7:37		Sample Composition:				
4031009-26	CP13B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 7:39		Sample Composition:				
4031009-27	CP14A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.012	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 7:40		Sample Composition:				
4031009-28	CP14B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.012	0.002	0.015	-	02/03/14 16:13

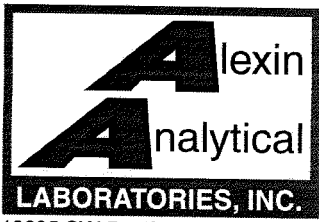

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N
T Phone: (503) 252-2900

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/16/14 7:41		Sample Composition:				
4031009-29	CP15A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.031	0.002	0.015	-	02/03/14 16:13 MCLE

Lab Number	Sample Name	Sampled: 1/16/14 7:43		Sample Composition:				
4031009-30	CP15B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.014	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/16/14 7:45		Sample Composition:				
4031009-31	CP16A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.021	0.002	0.015	-	02/03/14 16:13 MCLE

Lab Number	Sample Name	Sampled: 1/16/14 7:47		Sample Composition:				
4031009-32	CP16B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.024	0.002	0.015	-	02/03/14 16:13 MCLE

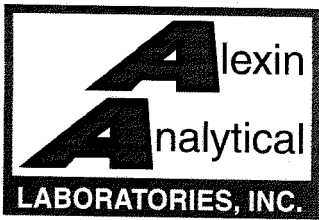

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/17/14 6:36		Sample Composition:				
4031009-33	CP19A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.016	0.002	0.015	-	02/03/14 16:13 MCLE

Lab Number	Sample Name	Sampled: 1/17/14 6:37		Sample Composition:				
4031009-34	CP19B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/17/14 6:41		Sample Composition:				
4031009-35	CP20A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.014	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/17/14 6:42		Sample Composition:				
4031009-36	CP20B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/03/14 16:13

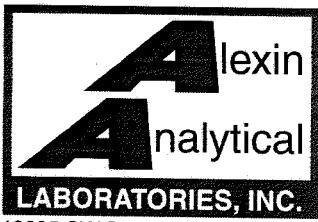

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/17/14 6:45		Sample Composition:				
4031009-37	CP21A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.011	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/17/14 6:46		Sample Composition:				
4031009-38	CP21B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/17/14 6:48		Sample Composition:				
4031009-39	CP22A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/17/14 6:49		Sample Composition:				
4031009-40	CP22B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	02/03/14 16:13

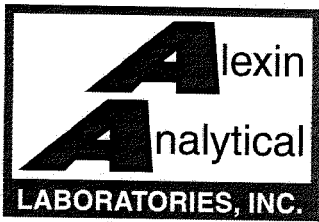

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

**C
L
I
E
N
T**
David Douglas School District
Attn: David Callaway
2900 SE 122nd
Portland OR, 97236
Phone: (503) 252-2900

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/17/14 6:51		Sample Composition:				
4031009-41	CP23A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	02/03/14 16:13

Lab Number	Sample Name	Sampled: 1/17/14 6:52		Sample Composition:				
4031009-42	CP23B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/17/14 6:55		Sample Composition:				
4031009-43	CP24A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.024	0.002	0.015	-	02/07/14 13:38 MCLE

Lab Number	Sample Name	Sampled: 1/17/14 6:56		Sample Composition:				
4031009-44	CP24B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.026	0.002	0.015	-	02/07/14 13:38 MCLE

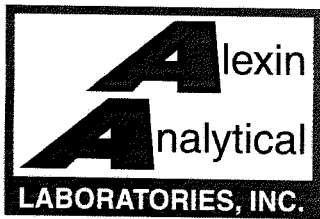

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/17/14 10:38		Sample Composition:				
4031009-45	CPgymA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/17/14 10:39		Sample Composition:				
4031009-46	CPgymB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/17/14 7:14		Sample Composition:				
4031009-47	CPcafeA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/17/14 7:15		Sample Composition:				
4031009-48	CPcafeB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

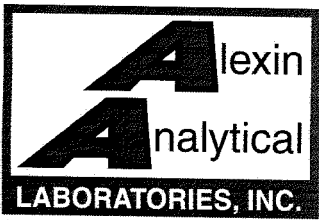

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/17/14 7:05		Sample Composition:				
4031009-49	CPHALLRM4A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.012	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/17/14 7:06		Sample Composition:				
4031009-50	CPHALLRM4B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.028	0.002	0.015	-	02/07/14 13:38 MCLE

Lab Number	Sample Name	Sampled: 1/17/14 7:07		Sample Composition:				
4031009-51	CPHALLRM27A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/17/14 7:08		Sample Composition:				
4031009-52	CPHALLRM27B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

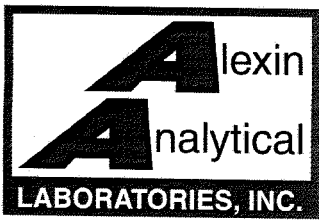

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/17/14 7:11		Sample Composition:				
4031009-53	CPHALLRM10A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.022	0.002	0.015	-	02/07/14 13:38 MCLE

Lab Number	Sample Name	Sampled: 1/17/14 7:12		Sample Composition:				
4031009-54	CPHALLRM10B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.024	0.002	0.015	-	02/07/14 13:38 MCLE

Lab Number	Sample Name	Sampled: 1/17/14 10:42		Sample Composition:				
4031009-55	CPHALLRM22A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/17/14 10:44		Sample Composition:				
4031009-56	CPHALLRM22B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

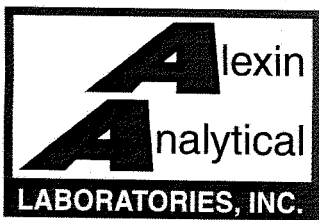

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/17/14 10:46		Sample Composition:				
4031009-57	CPHALLGYMA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/17/14 10:47		Sample Composition:				
4031009-58	CPHALLGYMB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/17/14 10:50		Sample Composition:				
4031009-59	CPKITCHEN1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/17/14 10:52		Sample Composition:				
4031009-60	CPKITCHEN1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

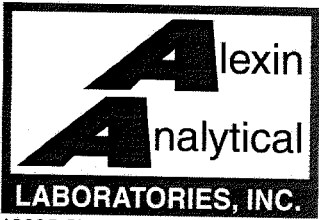

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By: Faye Bayer
Work Order: 4031009

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Cherry Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/17/14 0:00		Sample Composition:				
4031009-61	CPKITCHEN2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	0.073	0.004	0.015	-	02/07/14 13:38 MCLE

Lab Number	Sample Name	Sampled: 1/17/14 0:00		Sample Composition:				
4031009-62	CPKITCHEN2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	02/07/14 13:38

ND = None detected **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit
MCLE This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

Approved by: 
Scott Dickman
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.

