


DAVID DOUGLAS SCHOOL DISTRICT
LEAD TESTING RESULTS BY SCHOOL

6/6/2016 3:59 PM

Classroom/Location	Analysis Report Date	Work Order #	1st Draw	1 Min Draw	Action Taken
			Test #1 mg/L	Test #2 mg/L	
EARL BOYLES ELEMENTARY SCHOOL					
1	1/22/2014	4015005	nd	nd	none
2	1/22/2014	4015005	0.0020	nd	none
3	1/22/2014	4015005	0.0380	0.0040	Turned off
4	1/22/2014	4015005	nd	nd	none
5	1/22/2014	4015005	nd	nd	none
6	1/22/2014	4015005	nd	nd	none
7	1/22/2014	4015005	nd	nd	none
8	1/22/2014	4015005	nd	nd	none
9	1/22/2014	4015005	nd	nd	none
10	1/22/2014	4015005	nd	nd	none
11	1/22/2014	4015005	nd	nd	none
12	1/22/2014	4015005	nd	nd	none
13	1/22/2014	4015005	0.0020	nd	none
14	1/22/2014	4015005	nd	nd	none
15	1/22/2014	4015005	nd	nd	none
16	1/22/2014	4015005	nd	nd	none
17	1/22/2014	4015005	nd	nd	none
18	1/22/2014	4015005	nd	nd	none
19	1/22/2014	4015005	0.0020	nd	none
20	1/22/2014	4015005	nd	nd	none
21	1/22/2014	4015005	0.0030	nd	none
Hall 10	1/22/2014	4015005	nd	nd	none
Hall 11	1/22/2014	4015005	nd	nd	none
Hall RN	1/22/2014	4015005	nd	nd	none
Hall 19	1/22/2014	4015005	nd	nd	none
Gym	1/22/2014	4015005	nd	nd	none
Kitchen 1	1/22/2014	4015005	0.0080	nd	none
Kitchen 2	1/22/2014	4015005	0.0140	nd	none
Lobby 1	1/22/2014	4015005	nd	nd	none
Lobby 2	1/22/2014	4015005	nd	nd	none
Classroom 3 replace fixtures. Retesting completed.					
3	5/12/2016	6120002	nd	nd	Turned on/retest 6 months

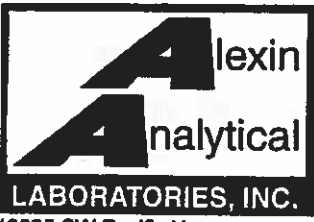

**Professional
Laboratory
Services**

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

**C
L
I
E
N
T**
David Douglas School District
Attn: David Callaway
2900 SE 122nd
Portland OR, 97236
Phone: (503) 252-2900

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/9/14 6:52		Sample Composition:				
4015005-01	EB 1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 6:54		Sample Composition:				
4015005-02	EB 1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 6:56		Sample Composition:				
4015005-03	EB 2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 6:58		Sample Composition:				
4015005-04	EB 2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

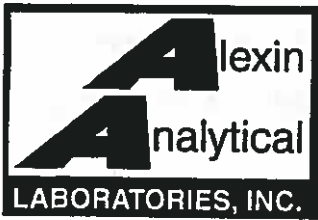

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Figard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/9/14 7:08		Sample Composition:				
4015005-05	EB 3A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.038	0.004	0.015	-	01/22/14 11:25 MCL

Lab Number	Sample Name	Sampled: 1/9/14 7:10		Sample Composition:				
4015005-06	EB 3B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	01/22/14 11:25

Lab Number	Sample Name	Sampled: 1/9/14 7:13		Sample Composition:				
4015005-07	EB 4A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:14		Sample Composition:				
4015005-08	EB 4B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

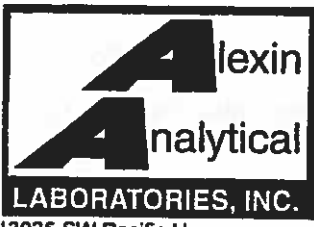

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/9/14 7:16		Sample Composition:				
4015005-09	EB 5A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:18		Sample Composition:				
4015005-10	EB 5B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:20		Sample Composition:				
4015005-11	EB 6A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:21		Sample Composition:				
4015005-12	EB 6B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

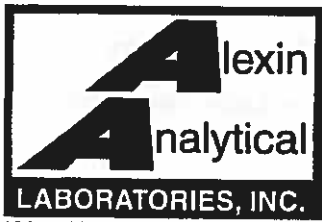

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/9/14 7:25		Sample Composition:				
4015005-13	EB 7A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:26		Sample Composition:				
4015005-14	EB 7B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:35		Sample Composition:				
4015005-15	EB 8A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:36		Sample Composition:				
4015005-16	EB 8B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

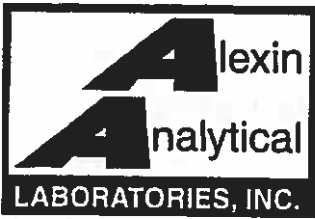

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

**C
L
I
E
N
T**
David Douglas School District
Attn: David Callaway
2900 SE 122nd
Portland OR, 97236
Phone: (503) 252-2900

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/9/14 7:28		Sample Composition:					
4015005-17	EB 9A								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22	

Lab Number	Sample Name	Sampled: 1/9/14 7:30		Sample Composition:					
4015005-18	EB 9B								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22	

Lab Number	Sample Name	Sampled: 1/9/14 7:41		Sample Composition:					
4015005-19	EB 10A								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22	

Lab Number	Sample Name	Sampled: 1/9/14 7:43		Sample Composition:					
4015005-20	EB 10B								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22	

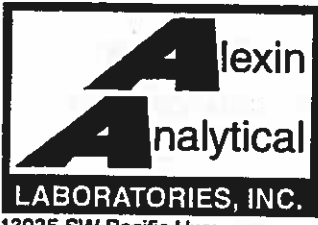

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/13/14 6:35		Sample Composition:				
4015005-21	EB 11A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/13/14 6:37		Sample Composition:				
4015005-22	EB 11B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/13/14 6:47		Sample Composition:				
4015005-23	EB 12A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/13/14 6:49		Sample Composition:				
4015005-24	EB 12B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

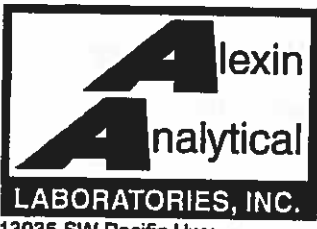

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

**C
L
I
E
N
T**
David Douglas School District
Attn: David Callaway
2900 SE 122nd
Portland OR, 97236
Phone: (503) 252-2900

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/13/14 6:57		Sample Composition:				
4015005-25	EB 13A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/13/14 7:00		Sample Composition:				
4015005-26	EB 13B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/13/14 7:02		Sample Composition:				
4015005-27	EB 14A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/13/14 7:03		Sample Composition:				
4015005-28	EB 14B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

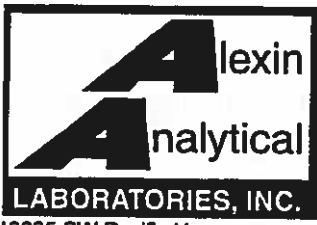

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 839-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/14/14 6:43		Sample Composition:				
4015005-29	EB 15A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/14/14 6:46		Sample Composition:				
4015005-30	EB 15B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/14/14 6:53		Sample Composition:				
4015005-31	EB 16A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/14/14 6:55		Sample Composition:				
4015005-32	EB 16B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

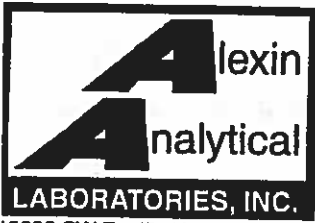

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/14/14 6:49		Sample Composition:				
4015005-33	EB 17A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/14/14 6:51		Sample Composition:				
4015005-34	EB 17B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/14/14 6:57		Sample Composition:				
4015005-35	EB 18A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/14/14 6:59		Sample Composition:				
4015005-36	EB 18B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/22/14 11:25

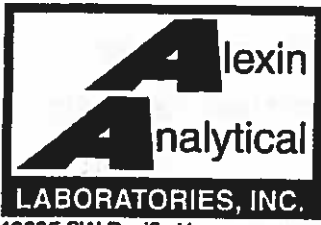

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/14/14 7:00		Sample Composition:				
4015005-37	EB 19A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/14/14 7:01		Sample Composition:				
4015005-38	EB 19B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/14/14 7:03		Sample Composition:				
4015005-39	EB 20A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/22/14 11:25

Lab Number	Sample Name	Sampled: 1/14/14 7:05		Sample Composition:				
4015005-40	EB 20B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

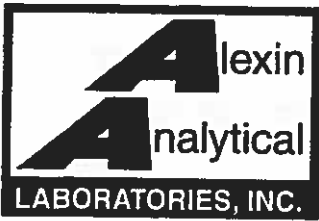

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

**C
L
I
E
N
T**
David Douglas School District
Attn: David Callaway
2900 SE 122nd
Portland OR, 97236
Phone: (503) 252-2900

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/9/14 7:08		Sample Composition:				
4015005-41	EB 21A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:09		Sample Composition:				
4015005-42	EB 21B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 6:40		Sample Composition:				
4015005-43	EB HALL10A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 6:42		Sample Composition:				
4015005-44	EB HALL10B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

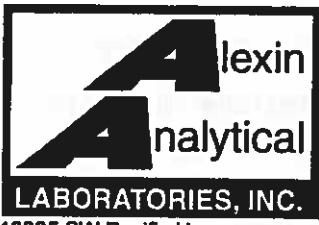

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/9/14 6:43		Sample Composition:				
4015005-45	EB HALL11A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 6:44		Sample Composition:				
4015005-46	EB HALL11B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:12		Sample Composition:				
4015005-47	EB HALL RNA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:13		Sample Composition:				
4015005-48	EB HALL RNB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

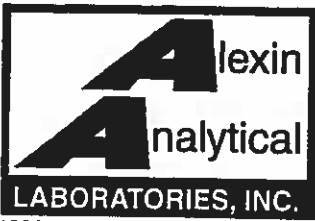

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

**C
L
I
E
N
T**
David Douglas School District
Attn: David Callaway
2900 SE 122nd
Portland OR, 97236
Phone: (503) 252-2900

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/9/14 7:14		Sample Composition:				
4015005-49	EB HALL 19A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 7:16		Sample Composition:				
4015005-50	EB HALL 19B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/13/14 6:52		Sample Composition:				
4015005-51	EB GYMA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/13/14 6:54		Sample Composition:				
4015005-52	EB GYMB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

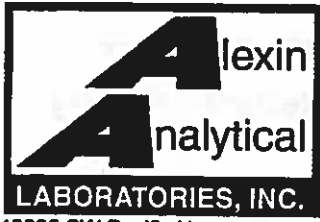

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/9/14 6:40		Sample Composition:				
4015005-53	EB Kitchen 1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 6:42		Sample Composition:				
4015005-54	EB Kitchen 1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/20/14 14:22

Lab Number	Sample Name	Sampled: 1/9/14 6:44		Sample Composition:				
4015005-55	EB Kitchen 2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.014	0.002	0.015	-	01/22/14 11:25

Lab Number	Sample Name	Sampled: 1/9/14 6:45		Sample Composition:				
4015005-56	EB Kitchen 2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/22/14 11:25

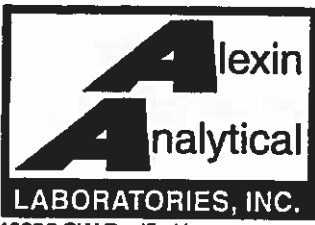

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

**Professional
Laboratory
Services**

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014
Received: 01/15/2014
Sampled By: Faye Bayer
Work Order: 4015005

C
L
I
E
N
T

David Douglas School District
Attn: David Callaway
2900 SE 122nd
Portland OR, 97236
Phone: (503) 252-2900

Project: -
Project # : N/A
PWSID # : -
PO # : 141765

Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/14/14 7:21		Sample Composition:				
4015005-57	EB Lobby 1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/22/14 11:25

Lab Number	Sample Name	Sampled: 1/14/14 7:23		Sample Composition:				
4015005-58	EB Lobby 1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/22/14 11:25

Lab Number	Sample Name	Sampled: 1/14/14 7:24		Sample Composition:				
4015005-59	EB Lobby 2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/22/14 11:25

Lab Number	Sample Name	Sampled: 1/14/14 7:26		Sample Composition:				
4015005-60	EB Lobby 2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/22/14 11:25



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014

Received: 01/15/2014

Sampled By: Faye Bayer

Work Order: 4015005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T


Project: -
Project # : N/A
PWSID # : -
PO # : 141765

Sampling Location: Earl Boyers
Sample Matrix: Drinking Water

ND = None detected **MRL = Minimum Reporting Limit** **MCL = Maximum Contamination Limit**

MCLE This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

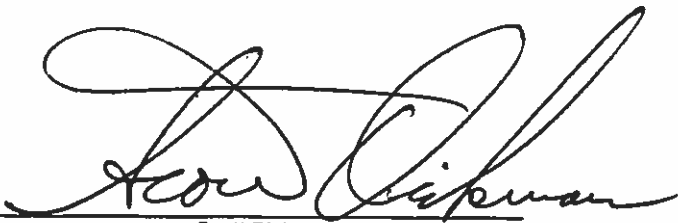Approved by: 
Scott Dickman
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

RECEIVED

MAY 25 2016

ACCOUNTS PAYABLE

Reported: 05/12/2016
Received: 04/29/2016
Sampled By: Troy Thompson
Work Order: 6120002

C
L
I
E
N
T

David Douglas School District

Attn: Troy Thompson

11300 NE Halsey St

Portland OR, 97220

Phone: (503) 252-2900

Project:

Project # : N/A

PWSID # :

Sampling Location: Varies

Sample Matrix: Water

Lab Number

	Code	Method	Units	Result	MRL	EPA MCL	Analysis Date/ Time
6120002-01 Sample Name: GP Cafe C Sampled: 4/17/16 6:17							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	05/09/16 17:17
6120002-02 Sample Name: GP Cafe D Sampled: 4/17/16 6:17							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	05/09/16 17:17
6120002-03 Sample Name: GP GC Sampled: 4/17/16 6:15							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	05/09/16 17:17
6120002-04 Sample Name: GP GD Sampled: 4/17/16 6:15							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-05 Sample Name: AO hall 9C Sampled: 4/17/16 6:45							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	05/09/16 17:17
6120002-06 Sample Name: AO hall 9D Sampled: 4/17/16 6:45							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-07 Sample Name: EB 3C Sampled: 4/17/16 6:30							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

RECEIVED

MAY 25 2016

ACCOUNTS PAYABLE

Reported: 05/12/2016
Received: 04/29/2016
Sampled By: Troy Thompson
Work Order: 6120002

C
L
I
E
N
T

David Douglas School District
Attn: Troy Thompson
11300 NE Halsey St
Portland OR, 97220
Phone: (503) 252-2900

Project:
Project # : N/A
PWSID # :

Sampling Location: Varies
Sample Matrix: Water

Lab Number

	Code	Method	Units	Result	MRL	EPA MCL	Analysis Date/ Time
6120002-08 Sample Name: EB 3D Sampled: 4/17/16 6:30							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-09 Sample Name: GH 20C Sampled: 4/17/16 6:45							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.095	0.008	0.015	05/09/16 17:17 MCLE
6120002-10 Sample Name: GH 20D Sampled: 4/17/16 6:45							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	05/09/16 17:17
6120002-11 Sample Name: GH CL #1A Sampled: 4/17/16 6:50							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	05/09/16 17:17
6120002-12 Sample Name: GH CL #1B Sampled: 4/17/16 6:50							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-13 Sample Name: GH hall 1D Sampled: 4/17/16 6:46							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	05/11/16 14:46
6120002-14 Sample Name: GH hall 1C Sampled: 4/17/16 6:45							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.023	0.002	0.015	05/11/16 14:46 MCLE



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

RECEIVED

MAY 25

ACCOUNTS PAYABLE

Reported: 05/12/2016
Received: 04/29/2016
Sampled By: Troy Thompson
Work Order: 6120002

C
L
I
E
N
T

David Douglas School District
Attn: Troy Thompson
11300 NE Halsey St
Portland OR, 97220
Phone: (503) 252-2900

Project:
Project # : N/A
PWSID # :

Sampling Location: Varies
Sample Matrix: Water

Lab Number

MCLE This analyte exceeds the MCL limit.

ND = None detected at the MRL **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit

†All procedures for this analysis are accredited in accordance with NELAP standards.

Approved by: _____

Adriana Gonzalez-Gray
Laboratory Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.