


**DAVID DOUGLAS SCHOOL DISTRICT
LEAD TESTING RESULTS BY SCHOOL**

6/6/2016 3:59 PM

Classroom/Location	Analysis Report Date	Work Order #	1st Draw	1 Min Draw	Action Taken
			Test #1 mg/L	Test #2 mg/L	
GILBERT PARK ELEMENTARY SCHOOL					
1	11/21/2013	3312023	0.0130	nd	none
2	11/21/2013	3312023	0.0090	0.0040	none
3	11/21/2013	3312023	0.0080	0.0040	none
4	11/21/2013	3312023	0.0090	0.0120	none
5	11/21/2013	3312023	0.0290	0.0190	Bubbler turned off/ Handwashing only
6	11/21/2013	3312023	0.0350	nd	Turned off
7	11/21/2013	3312023	0.0050	nd	none
8	11/21/2013	3312023	0.0050	nd	none
9	11/21/2013	3312023	0.0020	nd	none
10	11/21/2013	3312023	nd	nd	none
11	11/21/2013	3312023	0.0100	nd	none
12	11/21/2013	3312023	0.0130	0.0050	none
13	11/21/2013	3312023	0.0180	0.0070	Bubbler turned off/ Handwashing only
14	11/21/2013	3312023	0.0260	0.0190	Bubbler turned off/ Handwashing only
15	11/21/2013	3312023	0.0280	0.0250	Bubbler turned off/ Handwashing only
16	11/21/2013	3312023	0.0080	nd	none
17	11/21/2013	3312023	0.0090	nd	none
18	11/21/2013	3312023	0.0030	nd	none
19	11/21/2013	3312023	0.0030	nd	none
20	11/21/2013	3312023	0.0050	nd	none
21	11/21/2013	3312023	nd	nd	none
22	11/21/2013	3312023	nd	nd	none
23	11/21/2013	3312023	nd	nd	none
24	11/21/2013	3312023	nd	nd	none
Gym	11/21/2013	3312023	nd	nd	none
Cafeteria	11/21/2013	3312023	0.0170	0.0190	Turned off
Hall 20	11/21/2013	3312023	0.0080	0.0030	none
Hall 15	11/21/2013	3312023	0.0250	0.0250	Turned off
Hall 23	11/21/2013	3312023	0.0040	nd	none
Hall 22	11/21/2013	3312023	nd	nd	none
Kitchen 1	11/21/2013	3312023	0.0220	nd	Using flushing protocol - run for 10 minutes in a.m. prior to use; modified to 1 minute per EPA standards
Kitchen 2	11/21/2013	3312023	0.0040	nd	none
Gilbert Park has water delivery since 2013 for affected areas.					
Retesting:					
6	5/12/2016	6120002	0.0100	nd	Turned back on
Cafeteria	5/12/2016	6120002	0.0100	0.0080	Turned back on

ND - NONE DETECTED

ITEMS IN RED ARE OVER THE 20 PPB EPA RECOMMENDATION FOR REPLACEMENT

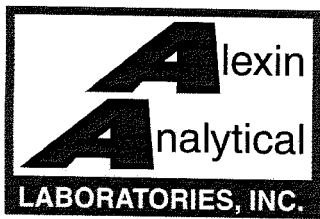

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 10/30/13 6:52 Sample Composition:						
3312023-01	GP1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.013	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 6:54 Sample Composition:						
3312023-02	GP1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 7:01 Sample Composition:						
3312023-03	GP2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 7:03 Sample Composition:						
3312023-04	GP2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 7:04 Sample Composition:						
3312023-05	GP3A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	11/18/13 12:35

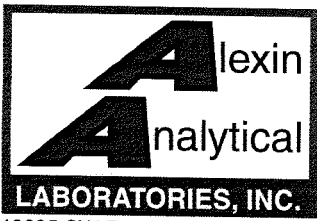

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 10/30/13 7:06 Sample Composition:						
3312023-06	GP3B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 7:13 Sample Composition:						
3312023-07	GP4A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 7:15 Sample Composition:						
3312023-08	GP4B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.012	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 7:16 Sample Composition:						
3312023-09	GP5A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.029	0.002	0.015	-	11/18/13 12:35 MCLE

Lab Number	Sample Name	Sampled: 10/30/13 7:17 Sample Composition:						
3312023-10	GP5B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.019	0.002	0.015	-	11/18/13 12:35 MCLE

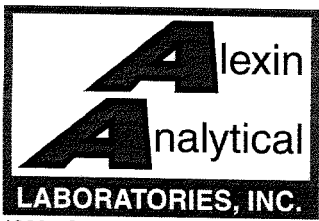

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water

Lab Number 3312023-11 **Sample Name** GP6A **Sampled:** 10/30/13 6:55 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.035	0.002	0.015	-	11/18/13 12:35 MCLE

Lab Number 3312023-12 **Sample Name** GP6B **Sampled:** 10/30/13 6:56 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/18/13 12:35

Lab Number 3312023-13 **Sample Name** GP7A **Sampled:** 10/30/13 6:58 **Sample Composition:**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	11/18/13 12:35

Lab Number 3312023-14 **Sample Name** GP7B **Sampled:** 10/30/13 6:59 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/18/13 12:35

Lab Number 3312023-15 **Sample Name** GP8A **Sampled:** 10/30/13 7:07 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	11/18/13 12:35

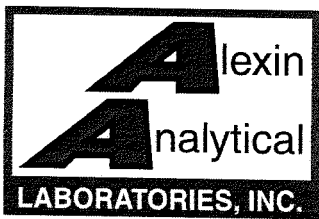

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water

Lab Number 3312023-16 **Sample Name** GP8B **Sampled:** 10/30/13 7:08 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/18/13 12:35

Lab Number 3312023-17 **Sample Name** GP9A **Sampled:** 10/30/13 7:09 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	11/18/13 12:35

Lab Number 3312023-18 **Sample Name** GP9B **Sampled:** 10/30/13 7:11 **Sample Composition:**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/18/13 12:35

Lab Number 3312023-19 **Sample Name** GP10A **Sampled:** 10/30/13 7:18 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/18/13 12:35

Lab Number 3312023-20 **Sample Name** GP10B **Sampled:** 10/30/13 7:19 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/18/13 12:35

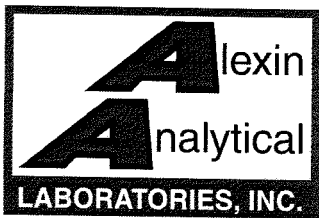

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 10/30/13 5:53 Sample Composition:						
3312023-21	GP11A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 5:54 Sample Composition:						
3312023-22	GP11B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 5:57 Sample Composition:						
3312023-23	GP12A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.013	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 5:59 Sample Composition:						
3312023-24	GP12B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 6:01 Sample Composition:						
3312023-25	GP13A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.018	0.002	0.015	-	11/18/13 12:35 MCLE

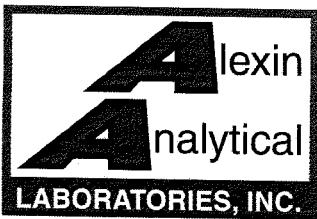

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 10/30/13 6:02 Sample Composition:						
3312023-26	GP13B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 6:04 Sample Composition:						
3312023-27	GP14A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.026	0.002	0.015	-	11/18/13 12:35 MCLE

Lab Number	Sample Name	Sampled: 10/30/13 6:05 Sample Composition:						
3312023-28	GP14B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.019	0.002	0.015	-	11/18/13 12:35 MCLE

Lab Number	Sample Name	Sampled: 10/30/13 6:07 Sample Composition:						
3312023-29	GP15A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.028	0.002	0.015	-	11/18/13 12:35 MCLE

Lab Number	Sample Name	Sampled: 10/30/13 6:09 Sample Composition:						
3312023-30	GP15B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.025	0.002	0.015	-	11/18/13 12:35 MCLE

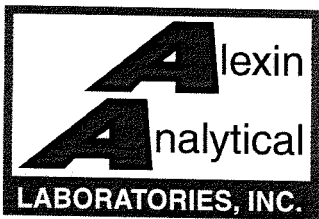

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 10/30/13 6:36 Sample Composition:						
3312023-31	GP16A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 6:38 Sample Composition:						
3312023-32	GP16B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 6:34 Sample Composition:						
3312023-33	GP17A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 6:35 Sample Composition:						
3312023-34	GP17B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/18/13 12:35

Lab Number	Sample Name	Sampled: 10/30/13 6:31 Sample Composition:						
3312023-35	GP18A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	11/18/13 12:35

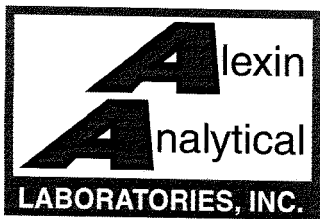

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water

Lab Number 3312023-36 **Sample Name** GP18B **Sampled:** 10/30/13 6:32 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/20/13 12:31

Lab Number 3312023-37 **Sample Name** GP19A **Sampled:** 10/30/13 6:27 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	11/13/13 15:43

Lab Number 3312023-38 **Sample Name** GP19B **Sampled:** 10/30/13 6:29 **Sample Composition:**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

Lab Number 3312023-39 **Sample Name** GP20A **Sampled:** 10/30/13 6:23 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	11/20/13 12:31

Lab Number 3312023-40 **Sample Name** GP20B **Sampled:** 10/30/13 6:24 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

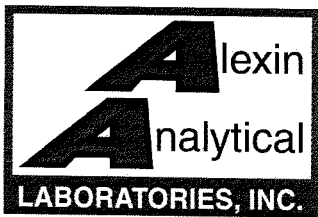

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 10/29/13 7:36 Sample Composition:							
3312023-41	GP21A								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43	

Lab Number	Sample Name	Sampled: 10/29/13 7:37 Sample Composition:							
3312023-42	GP21B								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43	

Lab Number	Sample Name	Sampled: 10/29/13 7:53 Sample Composition:							
3312023-43	GP23A								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43	

Lab Number	Sample Name	Sampled: 10/29/13 7:54 Sample Composition:							
3312023-44	GP23B								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43	

Lab Number	Sample Name	Sampled: 10/29/13 7:57 Sample Composition:							
3312023-45	GP24A								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43	

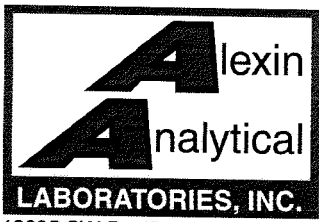

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

**Professional
Laboratory
Services**

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 10/29/13 7:59 Sample Composition:						
3312023-46	GP24B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

Lab Number	Sample Name	Sampled: 10/29/13 7:31 Sample Composition:						
3312023-47	GPGYMA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

Lab Number	Sample Name	Sampled: 10/29/13 7:32 Sample Composition:						
3312023-48	GPGYMB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/20/13 12:31

Lab Number	Sample Name	Sampled: 10/30/13 5:40 Sample Composition:						
3312023-49	GPCAFEA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.017	0.002	0.015	-	11/13/13 15:43 MCLE

Lab Number	Sample Name	Sampled: 10/30/13 5:41 Sample Composition:						
3312023-50	GPCAFEB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.019	0.002	0.015	-	11/20/13 12:31 MCLE

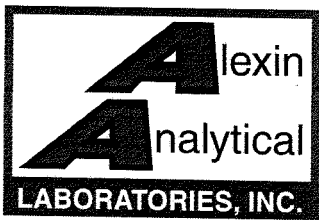

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 10/30/13 6:14 Sample Composition:						
3312023-51	GPHALL20A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	11/20/13 12:31

Lab Number	Sample Name	Sampled: 10/30/13 6:16 Sample Composition:						
3312023-52	GPHALL20B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	11/20/13 12:31

Lab Number	Sample Name	Sampled: 11/5/13 7:15 Sample Composition:						
3312023-53	GPHALL15A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.025	0.002	0.015	-	11/13/13 15:43 MCLE

Lab Number	Sample Name	Sampled: 11/5/13 7:17 Sample Composition:						
3312023-54	GPHALL15B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.025	0.002	0.015	-	11/13/13 15:43 MCLE

Lab Number	Sample Name	Sampled: 10/29/13 7:46 Sample Composition:						
3312023-55	GPHALL23A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	11/13/13 15:43

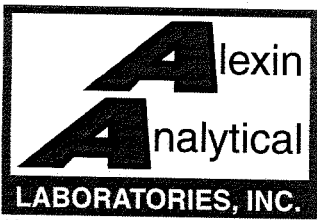

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

**Professional
Laboratory
Services**

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 10/29/13 7:48 Sample Composition:						
3312023-56	GPHALL23B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

Lab Number	Sample Name	Sampled: 10/29/13 7:49 Sample Composition:						
3312023-57	GPHALL22A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

Lab Number	Sample Name	Sampled: 10/29/13 7:50 Sample Composition:						
3312023-58	GPHALL22B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

Lab Number	Sample Name	Sampled: 10/29/13 7:40 Sample Composition:						
3312023-59	GP22A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

Lab Number	Sample Name	Sampled: 10/29/13 7:42 Sample Composition:						
3312023-60	GP22B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

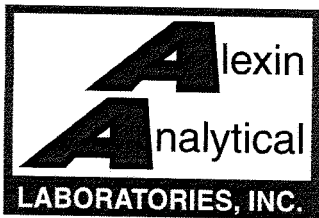

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 140989


Sampling Location: Gilbert Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 10/30/13 5:36 Sample Composition:						
3312023-61	GPKITCHEN1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.022	0.002	0.015	-	11/20/13 12:31 MCLE

Lab Number	Sample Name	Sampled: 10/30/13 5:37 Sample Composition:						
3312023-62	GPKITCHEN1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

Lab Number	Sample Name	Sampled: 10/30/13 5:36 Sample Composition:						
3312023-63	GPKITCHEN2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	11/13/13 15:43

Lab Number	Sample Name	Sampled: 10/30/13 5:38 Sample Composition:						
3312023-64	GPKITCHEN2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	11/13/13 15:43

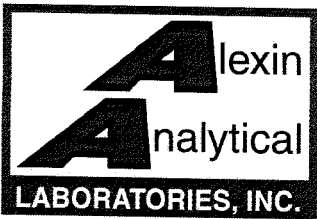

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

**Professional
Laboratory
Services**

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/21/2013
Received: 11/07/2013
Sampled By: Faye Bayer
Work Order: 3312023

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 140989

Sampling Location: Gilbert Park
Sample Matrix: Drinking Water

MCLE This analyte exceeds the MCL limit.

† All procedures for this analysis conform to NELAC standards.

ND = None detected **MRL** = Minimum Reporting Limit **MCL** = Maximum Contaminant Limit

Approved by:

Scott Dickman
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

RECEIVED

MAY 25 2016

ACCOUNTS PAYABLE

Reported: 05/12/2016
Received: 04/29/2016
Sampled By: Troy Thompson
Work Order: 6120002

C
L
I
E
N
T

David Douglas School District

Attn: Troy Thompson

11300 NE Halsey St

Portland OR, 97220

Phone: (503) 252-2900

Project:

Project # : N/A

PWSID # :

Sampling Location: Varies

Sample Matrix: Water

Lab Number

	Code	Method	Units	Result	MRL	EPA MCL	Analysis Date/ Time
6120002-01 Sample Name: GP Cafe C Sampled: 4/17/16 6:17							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	05/09/16 17:17
6120002-02 Sample Name: GP Cafe D Sampled: 4/17/16 6:17							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	05/09/16 17:17
6120002-03 Sample Name: GP GC Sampled: 4/17/16 6:15							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	05/09/16 17:17
6120002-04 Sample Name: GP GD Sampled: 4/17/16 6:15							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-05 Sample Name: AO hall 9C Sampled: 4/17/16 6:45							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	05/09/16 17:17
6120002-06 Sample Name: AO hall 9D Sampled: 4/17/16 6:45							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-07 Sample Name: EB 3C Sampled: 4/17/16 6:30							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

RECEIVED

MAY 25 2016

ACCOUNTS PAYABLE

Reported: 05/12/2016
Received: 04/29/2016
Sampled By: Troy Thompson
Work Order: 6120002

C
L
I
E
N
T

David Douglas School District
Attn: Troy Thompson
11300 NE Halsey St
Portland OR, 97220
Phone: (503) 252-2900

Project:
Project # : N/A
PWSID # :

Sampling Location: Varies
Sample Matrix: Water

Lab Number

	Code	Method	Units	Result	MRL	EPA MCL	Analysis Date/ Time
6120002-08	Sample Name: EB 3D Sampled: 4/17/16 6:30						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-09	Sample Name: GH 20C Sampled: 4/17/16 6:45						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.095	0.008	0.015	05/09/16 17:17 MCLE
6120002-10	Sample Name: GH 20D Sampled: 4/17/16 6:45						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	05/09/16 17:17
6120002-11	Sample Name: GH CL #1A Sampled: 4/17/16 6:50						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	05/09/16 17:17
6120002-12	Sample Name: GH CL #1B Sampled: 4/17/16 6:50						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	05/09/16 17:17
6120002-13	Sample Name: GH hall 1D Sampled: 4/17/16 6:46						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	05/11/16 14:46
6120002-14	Sample Name: GH hall 1C Sampled: 4/17/16 6:45						
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.023	0.002	0.015	05/11/16 14:46 MCLE



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

RECEIVED

MAY 25

ACCOUNTS PAYABLE

Reported: 05/12/2016
Received: 04/29/2016
Sampled By: Troy Thompson
Work Order: 6120002

C
L
I
E
N
T

David Douglas School District
Attn: Troy Thompson
11300 NE Halsey St
Portland OR, 97220
Phone: (503) 252-2900

Project:
Project # : N/A
PWSID # :

Sampling Location: Varies
Sample Matrix: Water

Lab Number

MCLE This analyte exceeds the MCL limit.

ND = None detected at the MRL **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit

†All procedures for this analysis are accredited in accordance with NELAP standards.

Approved by: _____

Adriana Gonzalez-Gray
Laboratory Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.