


**DAVID DOUGLAS SCHOOL DISTRICT  
LEAD TESTING RESULTS BY SCHOOL**

6/6/2016 3:59 PM

Classroom/Location	Analysis Report Date	Work Order #	1st Draw	1 Min Draw	Action Taken
			Test #1 mg/L	Test #2 mg/L	
<b>LINCOLN PARK ELEMENTARY SCHOOL</b>					
1	10/31/2013	3297023	0.0180	nd	Disabled - retesting 6/2015
2	10/31/2013	3297023	0.0030	nd	none
3	10/31/2013	3297023	0.0020	nd	none
4	10/31/2013	3297023	0.0020	nd	none
5	10/31/2013	3297023	0.0090	nd	none
6	10/31/2013	3297023	0.0030	nd	none
7	10/31/2013	3297023	0.0060	nd	none
8	10/31/2013	3297023	nd	nd	none
9	10/31/2013	3297023	0.0040	nd	none
10	10/31/2013	3297023	ND	ND	none
11	10/31/2013	3297023	0.0050	nd	none
12	10/31/2013	3297023	0.0050	nd	none
13	10/31/2013	3297023	0.0060	nd	none
14	10/31/2013	3297023	0.0050	nd	none
15	10/31/2013	3297023	0.0070	nd	none
16	10/31/2013	3297023	0.0070	nd	none
17	10/31/2013	3297023	0.0040	nd	none
18	10/31/2013	3297023	0.0030	nd	none
19	10/31/2013	3297023	0.0080	nd	none
20	10/31/2013	3297023	0.0050	nd	none
21	10/31/2013	3297023	0.0070	nd	none
22	10/31/2013	3297023	0.0040	nd	none
23	10/31/2013	3297023	0.0040	nd	none
24	10/31/2013	3297023	0.0060	nd	none
25	10/31/2013	3297023	0.0080	nd	none
26	10/31/2013	3297023	nd	nd	none
27	10/31/2013	3297023	nd	nd	none
Office	10/31/2013	3297023	0.0030	nd	none
Cafeteria	10/31/2013	3297023	nd	nd	none
Gym	10/31/2013	3297023	0.0050	nd	none
Kitchen 1	10/31/2013	3297023	0.0050	nd	none
Kitchen 2	10/31/2013	3297023	0.0020	nd	none
Staff	10/31/2013	3297023	0.0040	nd	none

ND - NONE DETECTED

ITEMS IN RED ARE OVER THE 20 PPB EPA RECOMMENDATION FOR REPLACEMENT

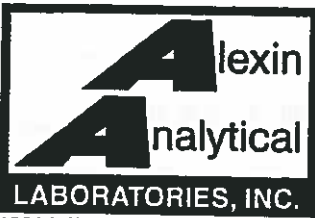

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

Project: -  
Project #: N/A  
PWSID #: -


Sampling Location: Lincoln Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 10/23/13 6:47		Sample Composition:				
<b>3297023-01</b>	LP1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.018</b>	0.002	0.015	-	10/30/13 14:57 MCL

Lab Number	Sample Name	Sampled: 10/23/13 6:49		Sample Composition:				
<b>3297023-02</b>	LP1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/23/13 6:51		Sample Composition:				
<b>3297023-03</b>	LP2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/23/13 6:53		Sample Composition:				
<b>3297023-04</b>	LP2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

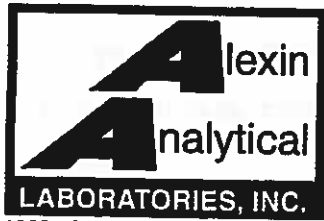

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C  
L  
I  
E  
N  
T**  
David Douglas School District  
Attn: David Callaway  
2900 SE 122nd  
Portland OR, 97236  
Phone: (503) 252-2900

**Project:** -  
**Project # :** N/A  
**PWSID # :** -


**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

Lab Number	Sample Name	Sampled: 10/23/13 6:38		Sample Composition:				
<b>3297023-05</b>	<b>LP3A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/23/13 6:40		Sample Composition:				
<b>3297023-06</b>	<b>LP3B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/23/13 6:43		Sample Composition:				
<b>3297023-07</b>	<b>LP4A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/23/13 6:45		Sample Composition:				
<b>3297023-08</b>	<b>LP4B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

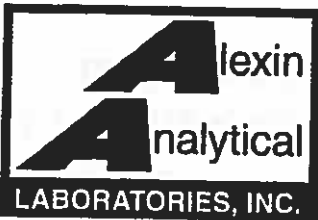

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -


**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

Lab Number	Sample Name	Sampled: 10/23/13 6:20		Sample Composition:				
<b>3297023-09</b>	<b>LP5A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/23/13 6:22		Sample Composition:				
<b>3297023-10</b>	<b>LP5B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/23/13 6:30		Sample Composition:				
<b>3297023-11</b>	<b>LP6A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/23/13 6:33		Sample Composition:				
<b>3297023-12</b>	<b>LP6B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

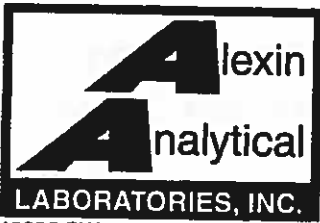

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -


**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

Lab Number	Sample Name	Sampled: 10/23/13 6:12		Sample Composition:				
<b>3297023-13</b>	<b>LP7A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/23/13 6:15		Sample Composition:				
<b>3297023-14</b>	<b>LP7B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/23/13 6:17		Sample Composition:				
<b>3297023-15</b>	<b>LP8A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/23/13 6:18		Sample Composition:				
<b>3297023-16</b>	<b>LP8B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

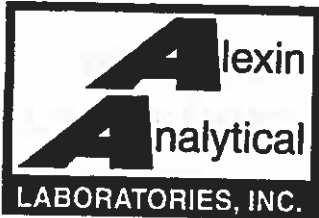

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -


**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

Lab Number	Sample Name	Sampled: 10/23/13 6:06		Sample Composition:				
<b>3297023-17</b>	<b>LP9A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/23/13 6:08		Sample Composition:				
<b>3297023-18</b>	<b>LP9B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/23/13 6:09		Sample Composition:				
<b>3297023-19</b>	<b>LP10A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/23/13 6:11		Sample Composition:				
<b>3297023-20</b>	<b>LP10B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

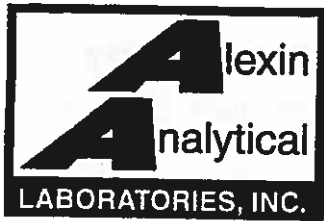

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -

**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

**Lab Number** 3297023-21      **Sample Name** LP12A      **Sampled:** 10/23/13 5:43      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	10/30/13 14:57

**Lab Number** 3297023-22      **Sample Name** LP12B      **Sampled:** 10/23/13 5:45      **Sample Composition:**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

**Lab Number** 3297023-23      **Sample Name** LP14A      **Sampled:** 10/23/13 5:37      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	10/30/13 14:57

**Lab Number** 3297023-24      **Sample Name** LP14B      **Sampled:** 10/23/13 5:39      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

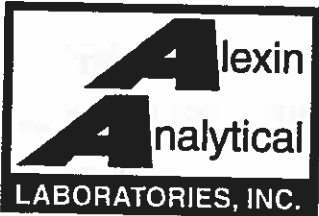

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N**  
**T** Phone: (503) 252-2900

**Project:** -  
**Project # :** N/A  
**PWSID # :** -

**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water


Lab Number	Sample Name	Sampled: 10/23/13 5:30		Sample Composition:					
<b>3297023-25</b>	<b>LP15A</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	10/30/13 14:57	

Lab Number	Sample Name	Sampled: 10/23/13 5:33		Sample Composition:					
<b>3297023-26</b>	<b>LP15B</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57	

Lab Number	Sample Name	Sampled: 10/23/13 5:26		Sample Composition:					
<b>3297023-27</b>	<b>LP16A</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	10/30/13 14:57	

Lab Number	Sample Name	Sampled: 10/23/13 5:28		Sample Composition:					
<b>3297023-28</b>	<b>LP16B</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57	



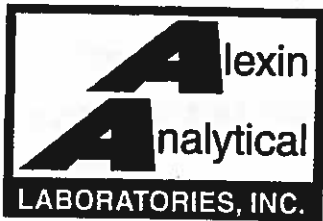

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -


**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

Lab Number	Sample Name	Sampled: 10/23/13 5:19		Sample Composition:				
<b>3297023-29</b>	<b>LP17A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/23/13 5:21		Sample Composition:				
<b>3297023-30</b>	<b>LP17B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/22/13 7:45		Sample Composition:				
<b>3297023-31</b>	<b>LP18A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/22/13 7:47		Sample Composition:				
<b>3297023-32</b>	<b>LP18B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

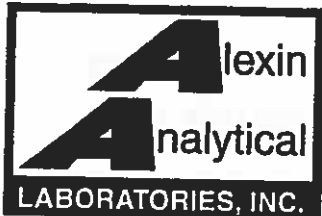

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -


**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

Lab Number	Sample Name	Sampled: 10/22/13 7:40		Sample Composition:				
<b>3297023-33</b>	<b>LP19A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/22/13 7:42		Sample Composition:				
<b>3297023-34</b>	<b>LP19B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/22/13 7:36		Sample Composition:				
<b>3297023-35</b>	<b>LP20A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	10/30/13 14:57

Lab Number	Sample Name	Sampled: 10/22/13 7:38		Sample Composition:				
<b>3297023-36</b>	<b>LP20B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

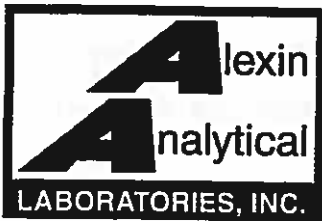

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

Project: -  
Project #: N/A  
PWSID #: -


Sampling Location: Lincoln Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 10/22/13 7:32		Sample Composition:				
<b>3297023-37</b>	<b>LP21A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/22/13 7:34		Sample Composition:				
<b>3297023-38</b>	<b>LP21B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/22/13 7:27		Sample Composition:				
<b>3297023-39</b>	<b>LP22A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/22/13 7:29		Sample Composition:				
<b>3297023-40</b>	<b>LP22B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

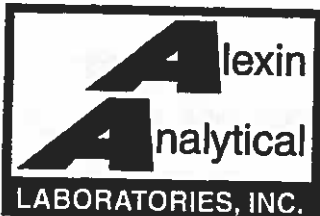

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -


**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

Lab Number	Sample Name	Sampled: 10/22/13 7:23		Sample Composition:				
<b>3297023-41</b>	<b>LP23A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/22/13 7:25		Sample Composition:				
<b>3297023-42</b>	<b>LP23B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/22/13 7:19		Sample Composition:				
<b>3297023-43</b>	<b>LP24A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/22/13 7:20		Sample Composition:				
<b>3297023-44</b>	<b>LP24B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

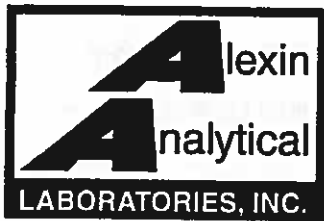

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C  
L  
I  
E  
N  
T**  
**David Douglas School District**  
Attn: David Callaway  
2900 SE 122nd  
Portland OR, 97236  
Phone: (503) 252-2900

**Project:** -  
**Project # :** N/A  
**PWSID # :** -

**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

**Lab Number**      **Sample Name**      **Sampled:** 10/22/13 7:14      **Sample Composition:**  
**3297023-45**      **LP25A**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	10/28/13 14:49

**Lab Number**      **Sample Name**      **Sampled:** 10/22/13 7:16      **Sample Composition:**  
**3297023-46**      **LP25B**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

**Lab Number**      **Sample Name**      **Sampled:** 10/23/13 7:13      **Sample Composition:**  
**3297023-47**      **LP26A**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

**Lab Number**      **Sample Name**      **Sampled:** 10/23/13 7:15      **Sample Composition:**  
**3297023-48**      **LP26B**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

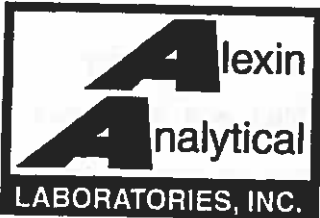

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

Project: -  
Project #: N/A  
PWSID #: -

Sampling Location: Lincoln Park  
Sample Matrix: Drinking Water

**Lab Number** 3297023-49      **Sample Name** LP27A      **Sampled:** 10/23/13 7:08      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

**Lab Number** 3297023-50      **Sample Name** LP27B      **Sampled:** 10/23/13 7:10      **Sample Composition:**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

**Lab Number** 3297023-51      **Sample Name** LP13A      **Sampled:** 10/23/13 5:40      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	10/28/13 14:49

**Lab Number** 3297023-52      **Sample Name** LP13B      **Sampled:** 10/23/13 5:42      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

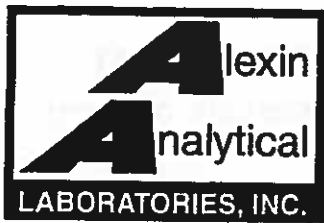

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -


**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

Lab Number	Sample Name	Sampled: 10/22/13 6:45		Sample Composition:				
<b>3297023-53</b>	<b>LP11A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/22/13 6:46		Sample Composition:				
<b>3297023-54</b>	<b>LP11B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/23/13 6:56		Sample Composition:				
<b>3297023-55</b>	<b>LPOFFICEA</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/23/13 6:57		Sample Composition:				
<b>3297023-56</b>	<b>LPOFFICEB</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

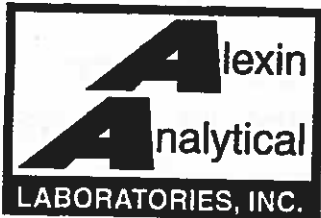

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project #:** N/A  
**PWSID #:** -

**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water


Lab Number	Sample Name	Sampled: 10/22/13 6:54		Sample Composition:				
<b>3297023-57</b>	<b>LPCAFAEA</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/22/13 6:56		Sample Composition:				
<b>3297023-58</b>	<b>LPCAFOB</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/22/13 7:10		Sample Composition:				
<b>3297023-59</b>	<b>LPGYMA</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	10/28/13 14:49

Lab Number	Sample Name	Sampled: 10/22/13 7:12		Sample Composition:				
<b>3297023-60</b>	<b>LPGYMB</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49



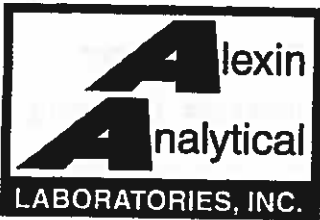

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

Project: -  
Project #: N/A  
PWSID #: -

Sampling Location: Lincoln Park  
Sample Matrix: Drinking Water

**Lab Number** 3297023-61      **Sample Name** LPKITCHEN1A      **Sampled:** 10/23/13 5:11      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	10/30/13 14:57

**Lab Number** 3297023-62      **Sample Name** LPKITCHEN1B      **Sampled:** 10/23/13 5:13      **Sample Composition:**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

**Lab Number** 3297023-63      **Sample Name** LPKITCHEN2A      **Sampled:** 10/23/13 5:12      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	10/28/13 14:49

**Lab Number** 3297023-64      **Sample Name** LPKITCHEN2B      **Sampled:** 10/23/13 5:14      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

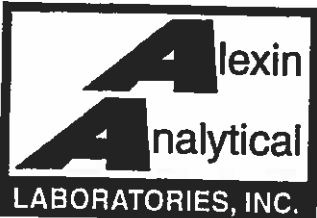

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 10/31/2013  
Received: 10/24/2013  
Sampled By: Faye Bayer  
Work Order: 3297023

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -

**Sampling Location:** Lincoln Park  
**Sample Matrix:** Drinking Water

**Lab Number**      **Sample Name**      **Sampled:** 10/23/13 7:02      **Sample Composition:**  
**3297023-65**      **LP StaffA**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	10/28/13 14:49

**Lab Number**      **Sample Name**      **Sampled:** 10/23/13 7:04      **Sample Composition:**  
**3297023-66**      **LP StaffB**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	10/28/13 14:49

**ND** = None detected      **MRL** = Minimum Reporting Limit      **MCL** = Maximum Contamination Limit

**MCLE** This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

Approved by:

Scott Dickman  
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.