

**DAVID DOUGLAS SCHOOL DISTRICT  
LEAD TESTING RESULTS BY SCHOOL**

6/6/2016 5:11 PM

Classroom/Location	Analysis Report Date	Work Order #	1st Draw	1 Min Draw	Action Taken
			Test #1 mg/L	Test #2 mg/L	
<b>MENLO PARK ELEMENTARY SCHOOL</b>					
1	1/17/2014	4002008	0.0350	0.0500	Turned off/Replaced bubbler 2/20/14 & retest
2	1/17/2014	4002008	0.0310	0.0030	Turned off
3	1/17/2014	4002008	0.0080	nd	none
4	1/17/2014	4002008	0.0090	nd	none
5	1/17/2014	4002008	0.0180	0.0040	Turned off
6	1/17/2014	4002008	0.0120	0.0070	none
7	1/17/2014	4002008	0.0230	0.0180	Turned off
8	1/17/2014	4002008	0.0090	0.0300	Turned off
9	1/17/2014	4002008			
10	1/17/2014	4002008	0.0460	0.0410	Turned off
11	1/17/2014	4002008	0.0600	0.0390	Turned off
12	1/17/2014	4002008	0.0680	0.1070	Turned off
13	1/17/2014	4002008	0.0600	0.0700	Turned off/Replaced bubbler 2/20/14 & retest
14	1/17/2014	4002008	0.0340	0.1130	Turned off
15	1/17/2014	4002008	0.0280	0.1030	Turned off
16	1/17/2014	4002008	0.0400	0.0830	Turned off
17	1/17/2014	4002008	0.0230	0.0620	Turned off
18	1/17/2014	4002008	0.0810	0.0360	Turned off
19	1/17/2014	4002008	0.0490	0.0540	Turned off
20	1/17/2014	4002008	0.0130	0.0560	Turned off/Replaced bubbler 2/20/14 & retest
21	1/17/2014	4002008	0.0740	0.0350	Turned off
22	1/17/2014	4002008	0.0680	0.0600	Turned off
23	1/17/2014	4002008	0.0430	0.0390	Turned off
24	1/17/2014	4002008	0.0630	0.0430	Turned off
25	1/17/2014	4002008	0.0290	0.0880	Turned off
Kitchen 1	1/17/2014	4002008	0.1440	0.0040	Turned off
Kitchen 2	1/17/2014	4002008	0.0960	nd	Turned off
Gym	1/17/2014	4002008	0.0140	0.0030	none
Cafeteria	1/17/2014	4002008	nd	0.0200	Closed
Hall 7	1/17/2014	4002008	0.0260	0.0190	Turned off
Hall Office	1/17/2014	4002008	0.0180	0.0040	Turned off
Hall Ktn 1	1/17/2014	4002008	nd	nd	none
Hall Ktn 2	1/17/2014	4002008	0.0030	nd	none
Hall 13	1/17/2014	4002008	0.0540	0.0770	Turned off
Hall Gym	1/17/2014	4002008	nd	0.0030	none
Hall 21	1/17/2014	4002008	0.0410	0.0710	Turned off
OSSA	2/6/2014	4031006	0.7620	0.0260	Hose bib - shut off
Boiler	2/6/2014	4031006	0.0030	nd	none
21	2/6/2014	4002008	0.0300	0.0090	Turned off
1	3/6/2014	4022704	0.0136	0.0129	Remain turned off
13	3/6/2014	4022704	0.0369	0.0364	Remain turned off
20	3/6/2014	4022704	0.0043	0.0013	Remain turned off
<b>Menlo Elementary had bottled water starting in spring 2014. Replaced three fixtures, determined pipes needed replacement. School repiped summer 2015.</b>					
<b>Retesting:</b>					
21	2/6/2014	4031006	0.0300	0.0090	Retest still high/continue off
					Retest after fixture replacement still
13	2/28/2014	4057003	0.0690	0.0610	high/remain off
20	2/28/2014	4057003	0.0070	0.0020	Test ok
					Retest after fixture replacement still
1	2/18/2014	4057003	0.0310	0.0400	high/remain off
8	9/6/2015	5251025	0.0090	n/a	Retest ok after pipe replacement

ND - NONE DETECTED

ITEMS IN RED ARE OVER THE 20 PPB EPA RECOMMENDATION FOR REPLACEMENT

**DAVID DOUGLAS SCHOOL DISTRICT  
LEAD TESTING RESULTS BY SCHOOL**

6/6/2016 5:11 PM

Classroom/Location	Analysis Report Date	Work Order #	1st Draw	1 Min Draw	Action Taken
			Test #1 mg/L	Test #2 mg/L	
Main @ entry	9/6/2015	5251025	0.0170	n/a	Test higher than 0.015/repiped from Vault to Building
DF @ A Hall	9/6/2015	5251025	0.0020	n/a	Retest ok after pipe replacement
25	11/20/2015	5321002	0.0030	n/a	Retest ok after pipe replacement
Main @ entry	11/20/2015	5321002	0.0040	n/a	Retest ok after vault to bldg redone
DF @ A Hall	11/20/2015	5321002	0.0030	n/a	Retest ok after pipe replacement
<b>School will be retested during summer of 2016. Water is on at building.</b>					



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project #:** N/A  
**PWSID #:** -  
**PO #:** 141528


**Sampling Location:** Menlo Park  
**Sample Matrix:** Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 7:49		Sample Composition:				
<b>4002008-01</b>	<b>MN1A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.035</b>	0.002	0.015	-	01/13/14 17:22 MCL

Lab Number	Sample Name	Sampled: 12/31/13 7:50		Sample Composition:				
<b>4002008-02</b>	<b>MN1B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.050</b>	0.004	0.015	-	01/13/14 17:22 MCL

Lab Number	Sample Name	Sampled: 12/31/13 8:00		Sample Composition:				
<b>4002008-03</b>	<b>MN2A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.031</b>	0.002	0.015	-	01/13/14 17:22 MCL

Lab Number	Sample Name	Sampled: 12/31/13 8:01		Sample Composition:				
<b>4002008-04</b>	<b>MN2B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/13/14 17:22

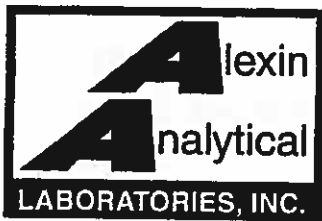

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C  
L  
I  
E  
N  
T**  
**David Douglas School District**  
Attn: David Callaway  
2900 SE 122nd  
Portland OR, 97236  
Phone: (503) 252-2900

**Project:** -  
**Project # :** N/A  
**PWSID # :** -  
**PO # :** 141528


**Sampling Location:** Menlo Park  
**Sample Matrix:** Drinking Water

<u>Lab Number</u>	<u>Sample Name</u>	Sampled: 12/31/13 8:18		Sample Composition:				
<b>4002008-05</b>	<b>MN3A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	01/13/14 17:22

<u>Lab Number</u>	<u>Sample Name</u>	Sampled: 12/31/13 8:19		Sample Composition:				
<b>4002008-06</b>	<b>MN3B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/13/14 17:22

<u>Lab Number</u>	<u>Sample Name</u>	Sampled: 12/31/13 8:21		Sample Composition:				
<b>4002008-07</b>	<b>MN4A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	01/13/14 17:22

<u>Lab Number</u>	<u>Sample Name</u>	Sampled: 12/31/13 8:22		Sample Composition:				
<b>4002008-08</b>	<b>MN4B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<i>†Lead</i>	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/13/14 17:22

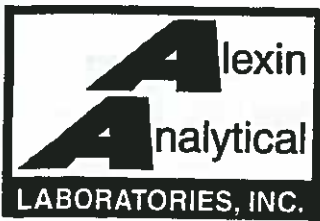

**Professional  
Laboratory  
Services**

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project #: N/A  
PWSID #: -  
PO #: 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 8:31		Sample Composition:				
<b>4002008-09</b>	<b>MN5A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.018</b>	0.002	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 8:32		Sample Composition:				
<b>4002008-10</b>	<b>MN5B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	01/13/14 17:22

Lab Number	Sample Name	Sampled: 12/31/13 8:34		Sample Composition:				
<b>4002008-11</b>	<b>MN6A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.012	0.002	0.015	-	01/13/14 17:22

Lab Number	Sample Name	Sampled: 12/31/13 8:35		Sample Composition:				
<b>4002008-12</b>	<b>MN6B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	01/13/14 17:22

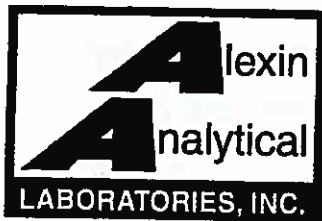

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -  
**PO # :** 141528

**Sampling Location:** Menlo Park  
**Sample Matrix:** Drinking Water

**Lab Number** 4002008-13      **Sample Name** MN7A      **Sampled:** 12/31/13 8:44      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.023	0.002	0.015	-	01/13/14 17:22 MCLE

**Lab Number** 4002008-14      **Sample Name** MN7B      **Sampled:** 12/31/13 8:45      **Sample Composition:**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.018	0.002	0.015	-	01/13/14 17:22 MCLE

**Lab Number** 4002008-15      **Sample Name** MN8A      **Sampled:** 12/31/13 8:46      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	01/13/14 17:22

**Lab Number** 4002008-16      **Sample Name** MN8B      **Sampled:** 12/31/13 8:47      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.030	0.002	0.015	-	01/13/14 17:22 MCLE

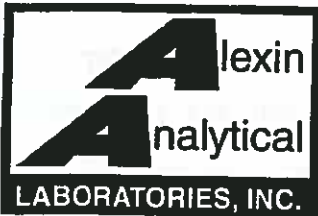

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 9:24		Sample Composition:					
<b>4002008-17</b>	<b>MN12A</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.068</b>	0.004	0.015	-	01/13/14 17:22 MCLE	

Lab Number	Sample Name	Sampled: 12/31/13 9:25		Sample Composition:					
<b>4002008-18</b>	<b>MN12B</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.107</b>	0.008	0.015	-	01/13/14 17:22 MCLE	

Lab Number	Sample Name	Sampled: 12/31/13 9:27		Sample Composition:					
<b>4002008-19</b>	<b>MN13A</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.060</b>	0.004	0.015	-	01/13/14 17:22 MCLE	

Lab Number	Sample Name	Sampled: 12/31/13 9:28		Sample Composition:					
<b>4002008-20</b>	<b>MN13B</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.070</b>	0.004	0.015	-	01/13/14 17:22 MCLE	

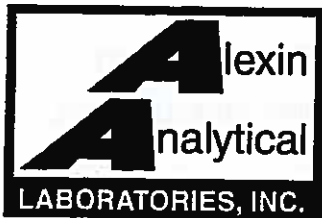

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C  
L  
I  
E  
N  
T**  
**David Douglas School District**  
Attn: David Callaway  
2900 SE 122nd  
Portland OR, 97236  
Phone: (503) 252-2900

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528

Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 9:42		Sample Composition:				
<b>4002008-21</b>	<b>MN14A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.034</b>	0.002	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:43		Sample Composition:				
<b>4002008-22</b>	<b>MN14B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.113</b>	0.008	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:44		Sample Composition:				
<b>4002008-23</b>	<b>MN15A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.028</b>	0.002	0.015	-	01/15/14 17:25 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:45		Sample Composition:				
<b>4002008-24</b>	<b>MN15B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.103</b>	0.008	0.015	-	01/13/14 17:22 MCLE





**Professional  
Laboratory  
Services**

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project #: N/A  
PWSID #: -  
PO #: 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 9:46		Sample Composition:				
<b>4002008-25</b>	<b>MN16A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.040</b>	0.004	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:47		Sample Composition:				
<b>4002008-26</b>	<b>MN16B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.083</b>	0.008	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:49		Sample Composition:				
<b>4002008-27</b>	<b>MN17A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.023</b>	0.002	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:50		Sample Composition:				
<b>4002008-28</b>	<b>MN17B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.062</b>	0.004	0.015	-	01/13/14 17:22 MCLE

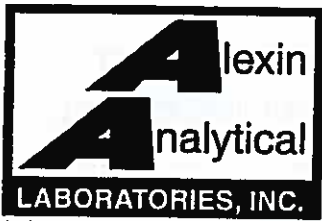

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 9:51		Sample Composition:				
<b>4002008-29</b>	<b>MN18A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.081</b>	0.008	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:52		Sample Composition:				
<b>4002008-30</b>	<b>MN18B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.036</b>	0.004	0.015	-	01/15/14 17:25 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:53		Sample Composition:				
<b>4002008-31</b>	<b>MN19A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.049</b>	0.004	0.015	-	01/15/14 17:25 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:54		Sample Composition:				
<b>4002008-32</b>	<b>MN19B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.054</b>	0.004	0.015	-	01/15/14 17:25 MCLE

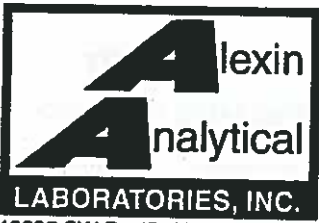

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project #: N/A  
PWSID #: -  
PO #: 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 10:06		Sample Composition:				
<b>4002008-33</b>	<b>MN20A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.013	0.002	0.015	-	01/15/14 17:25

Lab Number	Sample Name	Sampled: 12/31/13 10:07		Sample Composition:				
<b>4002008-34</b>	<b>MN20B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.056	0.004	0.015	-	01/15/14 17:25 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 10:09		Sample Composition:				
<b>4002008-35</b>	<b>MN21A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.074	0.004	0.015	-	01/15/14 17:25 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 10:10		Sample Composition:				
<b>4002008-36</b>	<b>MN21B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.035	0.002	0.015	-	01/13/14 17:22 MCLE

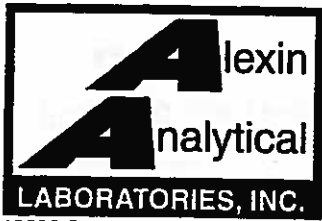

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 10:15		Sample Composition:				
<b>4002008-37</b>	<b>MN22A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.068</b>	0.004	0.015	-	01/13/14 17:22 MCL

Lab Number	Sample Name	Sampled: 12/31/13 10:16		Sample Composition:				
<b>4002008-38</b>	<b>MN22B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.060</b>	0.004	0.015	-	01/13/14 17:22 MCL

Lab Number	Sample Name	Sampled: 12/31/13 10:17		Sample Composition:				
<b>4002008-39</b>	<b>MN23A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.043</b>	0.004	0.015	-	01/13/14 17:22 MCL

Lab Number	Sample Name	Sampled: 12/31/13 10:18		Sample Composition:				
<b>4002008-40</b>	<b>MN23B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.039</b>	0.004	0.015	-	01/13/14 17:22 MCL

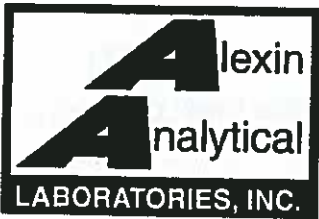

**Professional  
Laboratory  
Services**

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 10:22		Sample Composition:				
<b>4002008-41</b>	<b>MN24A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.063</b>	0.004	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 10:23		Sample Composition:				
<b>4002008-42</b>	<b>MN24B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.043</b>	0.004	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 10:24		Sample Composition:				
<b>4002008-43</b>	<b>MN25A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.029</b>	0.002	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 10:25		Sample Composition:				
<b>4002008-44</b>	<b>MN25B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.088</b>	0.008	0.015	-	01/13/14 17:22 MCLE

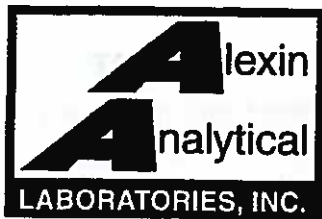

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 9:08		Sample Composition:				
<b>4002008-45</b>	<b>MNKITCHEN1A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.144</b>	0.008	0.015	-	01/15/14 17:25 MCL

Lab Number	Sample Name	Sampled: 12/31/13 9:09		Sample Composition:				
<b>4002008-46</b>	<b>MNKITCHEN1B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	01/13/14 17:22

Lab Number	Sample Name	Sampled: 12/31/13 9:08		Sample Composition:				
<b>4002008-47</b>	<b>MNKITCHEN2A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.096</b>	0.008	0.015	-	01/13/14 17:22 MCL

Lab Number	Sample Name	Sampled: 12/31/13 9:10		Sample Composition:				
<b>4002008-48</b>	<b>MNKITCHEN2B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/15/14 17:25

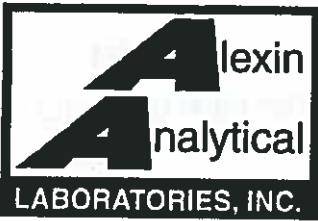

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C  
L  
I  
E  
N  
T**  
**David Douglas School District**  
Attn: David Callaway  
2900 SE 122nd  
Portland OR, 97236  
Phone: (503) 252-2900

**Project:** -  
**Project # :** N/A  
**PWSID # :** -  
**PO # :** 141528

**Sampling Location:** Menlo Park  
**Sample Matrix:** Drinking Water


Lab Number	Sample Name	Sampled: 12/31/13 9:59		Sample Composition:				
<b>4002008-49</b>	<b>MNGYMA</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.014	0.002	0.015	-	01/13/14 17:22

Lab Number	Sample Name	Sampled: 12/31/13 10:00		Sample Composition:				
<b>4002008-50</b>	<b>MNGYMB</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/13/14 17:22

Lab Number	Sample Name	Sampled: 12/31/13 9:35		Sample Composition:				
<b>4002008-51</b>	<b>MNCAFEA</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/13/14 17:22

Lab Number	Sample Name	Sampled: 12/31/13 9:36		Sample Composition:				
<b>4002008-52</b>	<b>MNCAFEB</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.020</b>	0.002	0.015	-	01/13/14 17:22 MCLE



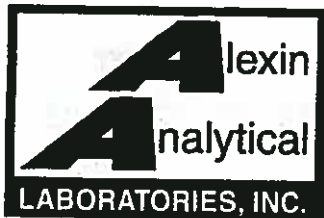

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528

Sampling Location: Menlo Park  
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 12/31/13 8:51		Sample Composition:				
<b>4002008-53</b>	<b>MNHALL7A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.026</b>	0.002	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 8:52		Sample Composition:				
<b>4002008-54</b>	<b>MNHALL7B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.019</b>	0.002	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 8:54		Sample Composition:				
<b>4002008-55</b>	<b>MNHALLOFFICEA</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.018</b>	0.002	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 8:55		Sample Composition:				
<b>4002008-56</b>	<b>MNHALLOFFICEB</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	01/13/14 17:22



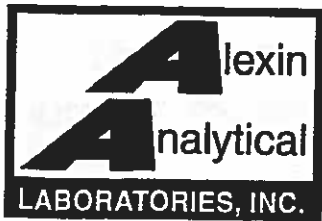

**Professional  
Laboratory  
Services**

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 9:00		Sample Composition:				
<b>4002008-57</b>	<b>MNHALLKTN1A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/13/14 17:22

Lab Number	Sample Name	Sampled: 12/31/13 9:01		Sample Composition:				
<b>4002008-58</b>	<b>MNHALLKTN1B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/13/14 17:22

Lab Number	Sample Name	Sampled: 12/31/13 9:02		Sample Composition:				
<b>4002008-59</b>	<b>MNHALLKTN2A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/13/14 17:22

Lab Number	Sample Name	Sampled: 12/31/13 9:03		Sample Composition:				
<b>4002008-60</b>	<b>MNHALLKTN2B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/13/14 17:22

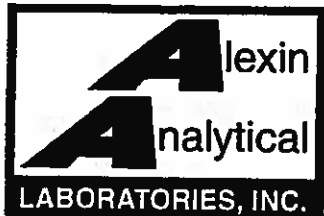

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 9:30		Sample Composition:				
<b>4002008-61</b>	<b>MNHALL13A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.054</b>	0.004	0.015	-	01/13/14 17:22 MCL

Lab Number	Sample Name	Sampled: 12/31/13 9:31		Sample Composition:				
<b>4002008-62</b>	<b>MNHALL13B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.077</b>	0.004	0.015	-	01/13/14 17:22 MCL

Lab Number	Sample Name	Sampled: 12/31/13 9:56		Sample Composition:				
<b>4002008-63</b>	<b>MNHALLGYMA</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/13/14 17:22

Lab Number	Sample Name	Sampled: 12/31/13 9:57		Sample Composition:				
<b>4002008-64</b>	<b>MNHALLGYMB</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/13/14 17:22

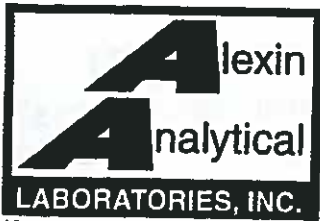

**Professional  
Laboratory  
Services**

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/31/13 10:12		Sample Composition:				
<b>4002008-65</b>	<b>MNHALL21A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.041</b>	0.004	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 10:13		Sample Composition:				
<b>4002008-66</b>	<b>MNHALL21B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.071</b>	0.004	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:16		Sample Composition:				
<b>4002008-67</b>	<b>MN10A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.046</b>	0.004	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:17		Sample Composition:				
<b>4002008-68</b>	<b>MN10B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.041</b>	0.004	0.015	-	01/13/14 17:22 MCLE

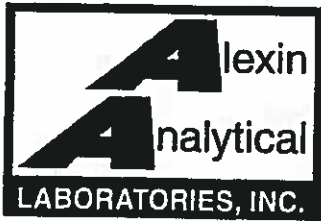

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002008

**C  
L  
I  
E  
N  
T**  
**David Douglas School District**  
Attn: David Callaway  
2900 SE 122nd  
Portland OR, 97236  
Phone: (503) 252-2900


**Project:** -  
**Project # :** N/A  
**PWSID # :** -  
**PO # :** 141528

**Sampling Location:** Menlo Park  
**Sample Matrix:** Drinking Water


Lab Number	Sample Name	Sampled: 12/31/13 9:19		Sample Composition:				
<b>4002008-69</b>	<b>MN11A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.060</b>	0.004	0.015	-	01/13/14 17:22 MCLE

Lab Number	Sample Name	Sampled: 12/31/13 9:20		Sample Composition:				
<b>4002008-70</b>	<b>MN11B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.039</b>	0.004	0.015	-	01/15/14 17:25 MCLE

ND = None detected      MRL = Minimum Reporting Limit      MCL = Maximum Contamination Limit  
MCLE This analyte exceeds the MCL limit.  
†All procedures for this analysis conform to NELAC standards.

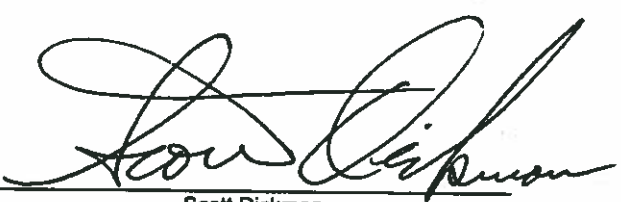Approved by:   
Scott Dickman  
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.

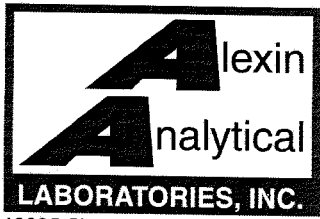

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 02/28/2014  
Received: 02/26/2014  
Sampled By:  
Work Order: 4057003

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 2/26/14 6:45		Sample Composition:				
<b>4057003-01</b>	<b>Menlo Park Room 1 1st Draw</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.031</b>	0.002	0.015	-	02/27/14 14:40 MCLE

Lab Number	Sample Name	Sampled: 2/26/14 6:47		Sample Composition:				
<b>4057003-02</b>	<b>Menlo Park Room 1 1 min</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.040</b>	0.002	0.015	-	02/27/14 14:40 MCLE

Lab Number	Sample Name	Sampled: 2/26/14 6:52		Sample Composition:				
<b>4057003-03</b>	<b>Menlo Park Room 1 5 min</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	02/27/14 14:40

Lab Number	Sample Name	Sampled: 2/26/14 7:05		Sample Composition:				
<b>4057003-04</b>	<b>Menlo Park Room 13 1st Draw</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.069</b>	0.004	0.015	-	02/27/14 14:40 MCLE

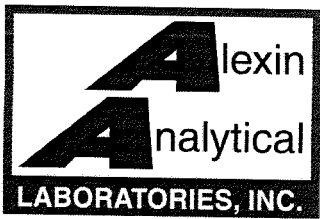

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 02/28/2014  
Received: 02/26/2014  
Sampled By:  
Work Order: 4057003

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -


Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled:	Sample Composition:					
<b>4057003-05</b>	<b>Menlo Park Room 13 1 min</b>	2/26/14 7:06						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.061</b>	0.004	0.015	-	02/27/14 14:40 MCLE

Lab Number	Sample Name	Sampled:	Sample Composition:					
<b>4057003-06</b>	<b>Menlo Park Room 13 5 min</b>	2/26/14 7:12						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.027</b>	0.002	0.015	-	02/27/14 14:40 MCLE

Lab Number	Sample Name	Sampled:	Sample Composition:					
<b>4057003-07</b>	<b>Menlo Park Room 20 1st Draw</b>	2/26/14 6:55						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	02/27/14 14:40

Lab Number	Sample Name	Sampled:	Sample Composition:					
<b>4057003-08</b>	<b>Menlo Park Room 20 1 min</b>	2/26/14 6:57						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	02/27/14 14:40

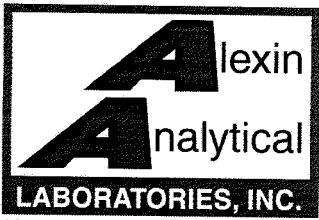

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 02/28/2014  
Received: 02/26/2014  
Sampled By:  
Work Order: 4057003

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**


**Project:** -  
Project # : N/A  
PWSID # : -

Sampling Location: Menlo Park  
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 2/26/14 7:02	Sample Composition:					
<b>4057003-09</b>	<b>Menlo Park Room 20 5 min</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/27/14 14:40


**ND** = None detected      **MRL** = Minimum Reporting Limit      **MCL** = Maximum Contamination Limit  
**MCLE** This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

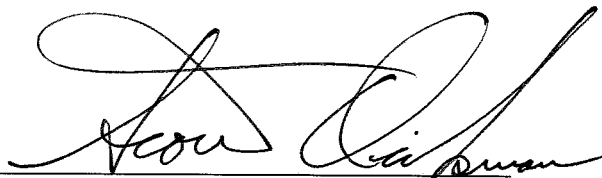Approved by: 

Scott Dickman  
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.

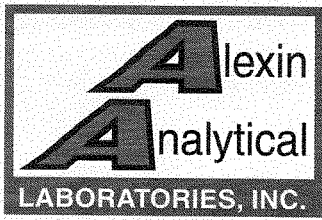

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 09/16/2015  
Received: 09/08/2015  
Sampled By: Max Roccoforte  
Work Order: 5251025

**C** David Douglas School District  
**L** Attn: -  
**I** 11300 NE Halsey St  
**E** Portland OR, 97220  
**N**  
**T** Phone: (503) 252-2900

**Project:** -  
Project # : N/A  
PWSID # : -

Sampling Location: Menlo Park  
Sample Matrix: Water

Lab Number	Sample Name	Sampled: 9/8/15 6:45		Sample Composition:					
<b>5251025-01</b>	<b>Main CW</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
+Lead	1030	EPA 200.9	mg/L	<b>0.017</b>	0.002	0.015	-	09/15/15 16:32 <b>MCLE</b>	

Lab Number	Sample Name	Sampled: 9/8/15 11:00		Sample Composition:					
<b>5251025-02</b>	<b>Bubbler @ 8</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
+Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	09/15/15 16:32	

Lab Number	Sample Name	Sampled: 9/8/15 11:15		Sample Composition:					
<b>5251025-03</b>	<b>DF-a @ (A) Hall</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
+Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	09/15/15 16:32	

**ND** = None detected      **MRL** = Minimum Reporting Limit      **MCL** = Maximum Contamination Limit


**MCLE** This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

Approved by:   
Adriana Gonzalez-Gray  
Laboratory Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.



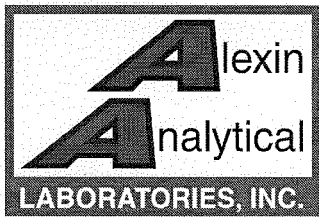

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

# ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 11/20/2015  
Received: 11/17/2015  
Sampled By:  
Work Order: 5321002

**C** David Douglas School District  
**L** Attn: -  
**I** 11300 NE Halsey St  
**E** Portland OR, 97220  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project #: N/A  
PWSID #: -

Sample Matrix: Water

## Lab Number

	Code	Method	Units	Result	MRL	EPA MCL	Analysis Date/ Time
<b>5321002-01</b> Sample Name: Mehlo-main @ ENTRY Sampled: 11/17/15 7:00							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	11/18/15 14:41
<b>5321002-02</b> Sample Name: Mehlo-DF-1 across Panel #1A Sampled: 11/17/15 7:10							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	11/18/15 14:41
<b>5321002-03</b> Sample Name: Mehlo-Rm 25 sink Sampled: 11/17/15 7:15							
<i>Metals (Total)</i>							
+Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	11/18/15 14:41

**ND** = None detected at the MRL    **MRL** = Minimum Reporting Limit    **MCL** = Maximum Contamination Limit  
†All procedures for this analysis conform to NELAC standards.

Approved by: \_\_\_\_\_

Adriana Gonzalez-Gray  
Laboratory Director