


DAVID DOUGLAS SCHOOL DISTRICT  
LEAD TESTING RESULTS BY SCHOOL

6/6/2016 3:59 PM

Classroom/Location	Analysis Report Date	Work Order #	1st Draw	1 Min Draw	Action Taken
			Test #1 mg/L	Test #2 mg/L	
<b>NORTH POWELLHURST ELEMENTARY SCHOOL</b>					
Hall 8	1/17/2014	4002009	0.0090	nd	none
Hall 7	1/17/2014	4002009	0.0130	nd	none
7	1/17/2014	4002009	0.0380	nd	Turned off/disabled
5	1/17/2014	4002009	0.0080	nd	none
3	1/17/2014	4002009	0.0050	nd	none
1	1/17/2014	4002009	0.0530	0.0030	Turned off
2	1/17/2014	4002009	0.0090	0.0030	none
Hall 2	1/17/2014	4002009	0.0110	0.0030	none
Hall 4	1/17/2014	4002009	0.0090	0.0030	none
4	1/17/2014	4002009	0.0030	nd	none
6	1/17/2014	4002009	nd	nd	none
8	1/17/2014	4002009	0.0050	nd	none
9	1/17/2014	4002009	0.0140	0.0290	Bubbler turned off/ Handwashing only
Hall 9	1/17/2014	4002009	nd	nd	none
Hall 10	1/17/2014	4002009	nd	nd	none
10	1/17/2014	4002009	0.0030	nd	none
11	1/17/2014	4002009	0.0060	nd	none
Kitchen 1	1/17/2014	4002009	0.0060	0.0060	none
					Using flushing protocol - run for 10 minutes in a.m. prior to use; modified to 1
Kitchen 2	1/17/2014	4002009	2.4800	0.0120	minute per EPA standards
Cafeteria 1	1/17/2014	4002009	0.0100	0.0080	none
Cafeteria 2	1/17/2014	4002009	0.0040	0.0100	none
12	1/17/2014	4002009	0.0030	0.0030	none
13	1/17/2014	4002009	0.0100	nd	none
14	1/17/2014	4002009	0.0300	nd	Bubbler turned off/disabled
15	1/17/2014	4002009	0.0070	nd	none
16	1/17/2014	4002009	0.0070	nd	none
17	1/17/2014	4002009	0.0090	nd	none
18	1/17/2014	4002009	0.0080	nd	none
Gym Hall 1	1/17/2014	4002009	0.0050	nd	none
Gym Hall 2	1/17/2014	4002009	0.0080	nd	none
Hall 15	1/17/2014	4002009	0.0100	nd	none
Hall 14	1/17/2014	4002009	0.0150	nd	none

ND - NONE DETECTED

ITEMS IN RED ARE OVER THE 20 PPB EPA RECOMMENDATION FOR REPLACEMENT

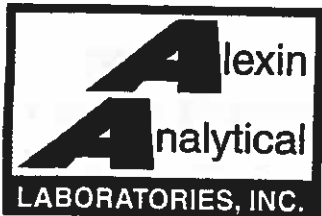

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -  
**PO # :** 141528


**Sampling Location:** North Powellhurst  
**Sample Matrix:** Water

Lab Number	Sample Name	Sampled: 12/26/13 13:13		Sample Composition:				
<b>4002009-01</b>	<b>NPHALLE8A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 13:14		Sample Composition:				
<b>4002009-02</b>	<b>NPHALLE8B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 13:14		Sample Composition:				
<b>4002009-03</b>	<b>NPHALLE7A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.013	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 13:15		Sample Composition:				
<b>4002009-04</b>	<b>NPHALLE7B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

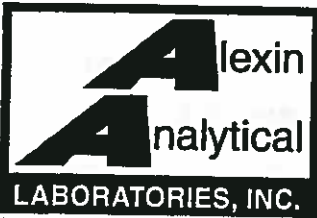

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C  
L  
I  
E  
N  
T**  
David Douglas School District  
Attn: David Callaway  
2900 SE 122nd  
Portland OR, 97236  
Phone: (503) 252-2900

Project: -  
Project #: N/A  
PWSID #: -  
PO #: 141528

Sampling Location: North Powellhurst  
Sample Matrix: Water

Lab Number	Sample Name	Sampled: 12/26/13 13:21		Sample Composition:					
<b>4002009-05</b>	<b>NPE7A</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
†Lead	1030	EPA 200.9	mg/L	<b>0.038</b>	0.002	0.015	-	01/07/14 16:46 MCL	

Lab Number	Sample Name	Sampled: 12/26/13 13:22		Sample Composition:					
<b>4002009-06</b>	<b>NPE7B</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46	

Lab Number	Sample Name	Sampled: 12/26/13 13:24		Sample Composition:					
<b>4002009-07</b>	<b>NPE5A</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
†Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	01/07/14 16:46	

Lab Number	Sample Name	Sampled: 12/26/13 13:25		Sample Composition:					
<b>4002009-08</b>	<b>NPE5B</b>								
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time	
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46	



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: North Powellhurst  
Sample Matrix: Water

Lab Number	Sample Name	Sampled: 12/26/13 13:26		Sample Composition:				
<b>4002009-09</b>	<b>NPE3A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 13:27		Sample Composition:				
<b>4002009-10</b>	<b>NPE3B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 13:30		Sample Composition:				
<b>4002009-11</b>	<b>NPE1A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.053	0.004	0.015	-	01/07/14 16:46 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 13:31		Sample Composition:				
<b>4002009-12</b>	<b>NPE1B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/07/14 16:46

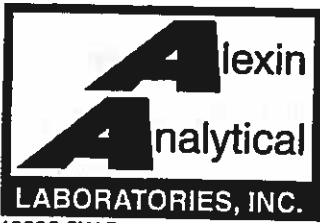

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: North Powellhurst  
Sample Matrix: Water

Lab Number	Sample Name	Sampled: 12/26/13 13:33		Sample Composition:				
<b>4002009-13</b>	<b>NPE2A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 13:34		Sample Composition:				
<b>4002009-14</b>	<b>NPE2B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 13:38		Sample Composition:				
<b>4002009-15</b>	<b>NPHALLE2A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.011	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 13:39		Sample Composition:				
<b>4002009-16</b>	<b>NPHALLE2B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/07/14 16:46

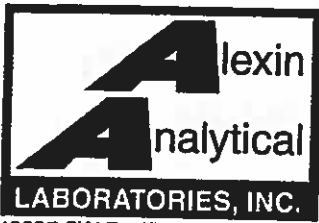

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528

Sampling Location: North Powellhurst  
Sample Matrix: Water

**Lab Number** 4002009-17      **Sample Name** NPHALLE4A      **Sampled:** 12/26/13 13:39      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	01/07/14 16:46

**Lab Number** 4002009-18      **Sample Name** NPHALLE4B      **Sampled:** 12/26/13 13:40      **Sample Composition:**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/08/14 15:33

**Lab Number** 4002009-19      **Sample Name** NPE4A      **Sampled:** 12/26/13 13:44      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/08/14 15:33

**Lab Number** 4002009-20      **Sample Name** NPE4B      **Sampled:** 12/26/13 13:45      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

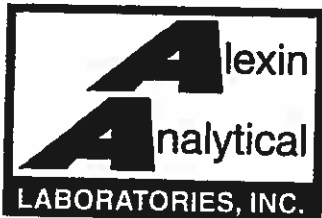

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 839-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
**Project # :** N/A  
**PWSID # :** -  
**PO # :** 141528


**Sampling Location:** North Powellhurst  
**Sample Matrix:** Water

Lab Number	Sample Name	Sampled: 12/26/13 13:48		Sample Composition:				
<b>4002009-21</b>	<b>NPE6A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/26/13 13:49		Sample Composition:				
<b>4002009-22</b>	<b>NPE6B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/26/13 13:53		Sample Composition:				
<b>4002009-23</b>	<b>NPE8A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/26/13 13:54		Sample Composition:				
<b>4002009-24</b>	<b>NPE8B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

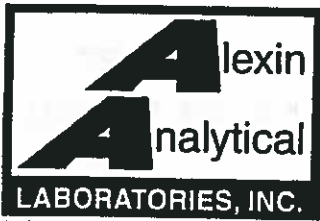

**Professional  
Laboratory  
Services**

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528

Sampling Location: North Powellhurst  
Sample Matrix: Water


Lab Number	Sample Name	Sampled: 12/26/13 13:56		Sample Composition:				
<b>4002009-25</b>	<b>NPE9A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.014	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/26/13 13:57		Sample Composition:				
<b>4002009-26</b>	<b>NPE9B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	<b>0.029</b>	0.002	0.015	-	01/08/14 15:33 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 14:02		Sample Composition:				
<b>4002009-27</b>	<b>NPHALLE9A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/26/13 14:03		Sample Composition:				
<b>4002009-28</b>	<b>NPHALLE9B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33



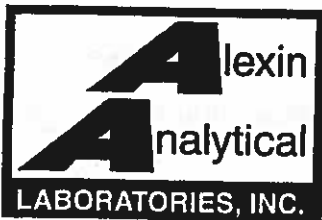

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project #: N/A  
PWSID #: -  
PO #: 141528

Sampling Location: North Powellhurst  
Sample Matrix: Water

**Lab Number** 4002009-29      **Sample Name** NPHALLE10A      **Sampled:** 12/26/13 14:03      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

**Lab Number** 4002009-30      **Sample Name** NPHALLE10B      **Sampled:** 12/26/13 14:04      **Sample Composition:**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

**Lab Number** 4002009-31      **Sample Name** NPE10A      **Sampled:** 12/26/13 14:06      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/08/14 15:33

**Lab Number** 4002009-32      **Sample Name** NPE10B      **Sampled:** 12/26/13 14:07      **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

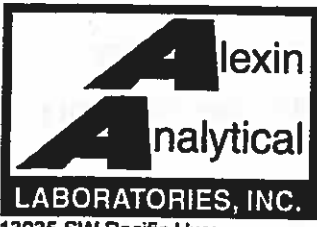

**Professional  
Laboratory  
Services**

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: North Powellhurst  
Sample Matrix: Water

Lab Number	Sample Name	Sampled: 12/26/13 14:10		Sample Composition:				
<b>4002009-33</b>	<b>NPE11A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/26/13 14:11		Sample Composition:				
<b>4002009-34</b>	<b>NPE11B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/26/13 14:16		Sample Composition:				
<b>4002009-35</b>	<b>NPKITCHEN1A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/26/13 14:18		Sample Composition:				
<b>4002009-36</b>	<b>NPKITCHEN1B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	01/08/14 15:33

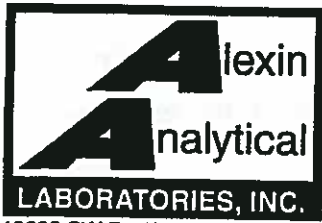

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: North Powellhurst  
Sample Matrix: Water

Lab Number	Sample Name	Sampled: 12/26/13 14:17		Sample Composition:				
<b>4002009-37</b>	<b>NPKITCHEN2A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	2.48	0.200	0.015	-	01/15/14 17:25 MCL

Lab Number	Sample Name	Sampled: 12/26/13 14:19		Sample Composition:				
<b>4002009-38</b>	<b>NPKITCHEN2B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.012	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 11:42		Sample Composition:				
<b>4002009-39</b>	<b>NPCAFE1A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	-	01/15/14 17:25

Lab Number	Sample Name	Sampled: 12/30/13 11:46		Sample Composition:				
<b>4002009-40</b>	<b>NPCAFE1B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	01/15/14 17:25

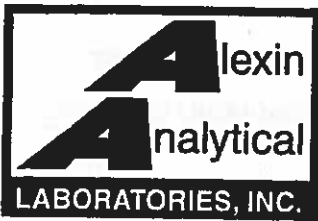

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528

Sampling Location: North Powellhurst  
Sample Matrix: Water

**Lab Number**      **Sample Name**      **Sampled:** 12/26/13 14:21      **Sample Composition:**  
**4002009-41**      **NPCAFA2A**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	01/15/14 17:25

**Lab Number**      **Sample Name**      **Sampled:** 12/26/13 14:22      **Sample Composition:**  
**4002009-42**      **NPCAFA2B**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	-	01/08/14 15:33

**Lab Number**      **Sample Name**      **Sampled:** 12/30/13 12:44      **Sample Composition:**  
**4002009-43**      **NPE12A**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/15/14 17:25

**Lab Number**      **Sample Name**      **Sampled:** 12/30/13 12:45      **Sample Composition:**  
**4002009-44**      **NPE12B**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/08/14 15:33



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: North Powellhurst  
Sample Matrix: Water

Lab Number	Sample Name	Sampled: 12/30/13 12:37		Sample Composition:				
<b>4002009-45</b>	<b>NPE13A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 12:38		Sample Composition:				
<b>4002009-46</b>	<b>NPE13B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 12:27		Sample Composition:				
<b>4002009-47</b>	<b>NPE14A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	<b>0.030</b>	0.002	0.015	-	01/08/14 15:33 MCL

Lab Number	Sample Name	Sampled: 12/30/13 12:28		Sample Composition:				
<b>4002009-48</b>	<b>NPE14B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

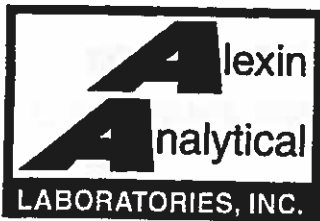

**Professional  
Laboratory  
Services**

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: North Powellhurst  
Sample Matrix: Water

Lab Number	Sample Name	Sampled: 12/30/13 12:18		Sample Composition:				
<b>4002009-49</b>	<b>NPE15A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	01/15/14 17:25

Lab Number	Sample Name	Sampled: 12/30/13 12:19		Sample Composition:				
<b>4002009-50</b>	<b>NPE15B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 12:12		Sample Composition:				
<b>4002009-51</b>	<b>NPE16A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 12:14		Sample Composition:				
<b>4002009-52</b>	<b>NPE16B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

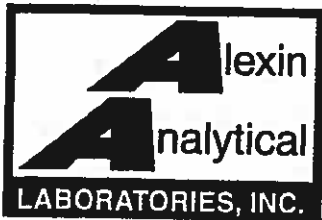

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C  
L  
I  
E  
N  
T**  
David Douglas School District  
Attn: David Callaway  
2900 SE 122nd  
Portland OR, 97236  
Phone: (503) 252-2900

**Project:** -  
Project #: N/A  
PWSID #: -  
PO #: 141528


Sampling Location: North Powellhurst  
Sample Matrix: Water

Lab Number	Sample Name	Sampled: 12/30/13 12:09		Sample Composition:				
<b>4002009-53</b>	<b>NPE17A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 12:10		Sample Composition:				
<b>4002009-54</b>	<b>NPE17B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 11:57		Sample Composition:				
<b>4002009-55</b>	<b>NPE18A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 11:58		Sample Composition:				
<b>4002009-56</b>	<b>NPE18B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

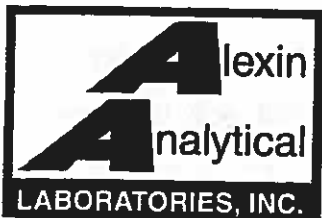

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528

Sampling Location: North Powellhurst  
Sample Matrix: Water


Lab Number	Sample Name	Sampled: 12/30/13 11:52		Sample Composition:				
<b>4002009-57</b>	<b>NPHALLGYM1A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 11:54		Sample Composition:				
<b>4002009-58</b>	<b>NPHALLGYM1B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 11:54		Sample Composition:				
<b>4002009-59</b>	<b>NPHALLGYM2A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	01/15/14 17:25

Lab Number	Sample Name	Sampled: 12/30/13 11:56		Sample Composition:				
<b>4002009-60</b>	<b>NPHALLGYM2B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
<sup>†</sup> Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33



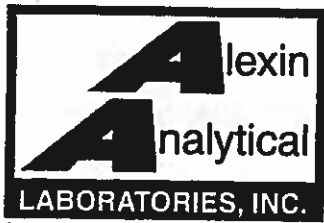

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: North Powellhurst  
Sample Matrix: Water

Lab Number	Sample Name	Sampled: 12/30/13 12:23		Sample Composition:				
<b>4002009-61</b>	<b>NPHALLE15A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 12:24		Sample Composition:				
<b>4002009-62</b>	<b>NPHALLE15B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 12:24		Sample Composition:				
<b>4002009-63</b>	<b>NPHALLE14A</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	0.015	0.002	0.015	-	01/08/14 15:33

Lab Number	Sample Name	Sampled: 12/30/13 12:25		Sample Composition:				
<b>4002009-64</b>	<b>NPHALLE14B</b>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/08/14 15:33

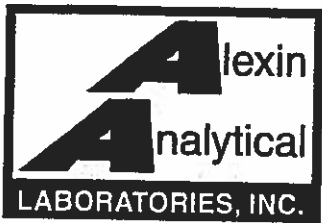

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**  
ORELAP Accredited Lab#: OR-100013

Reported: 01/17/2014  
Received: 01/02/2014  
Sampled By: Faye Bayer  
Work Order: 4002009

**C** David Douglas School District  
**L** Attn: David Callaway  
**I** 2900 SE 122nd  
**E** Portland OR, 97236  
**N** Phone: (503) 252-2900  
**T**

**Project:** -  
Project # : N/A  
PWSID # : -  
PO # : 141528


Sampling Location: North Powellhurst  
Sample Matrix: Water

---

**ND** = None detected    **MRL** = Minimum Reporting Limit    **MCL** = Maximum Contamination Limit

**MCLE** This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

Approved by: 

Scott Dickman  
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.