


**DAVID DOUGLAS SCHOOL DISTRICT
LEAD TESTING RESULTS BY SCHOOL**

6/6/2016 3:59 PM

Classroom/Location	Analysis Report Date	Work Order #	1st Draw		1 Min Draw		Action Taken
			Test #1 mg/L	Test #2 mg/L	Test #1 mg/L	Test #2 mg/L	
RON RUSSELL MIDDLE SCHOOL							
Gym 1	2/10/2014	4031005	nd	nd	nd	nd	none
Gym 2	2/10/2014	4031005	nd	nd	nd	nd	none
Gym 3 Up	2/10/2014	4031005	nd	nd	nd	nd	none
Boys 1	2/10/2014	4031005	nd	nd	nd	nd	none
Boys 2	2/10/2014	4031005	nd	nd	nd	nd	none
Girls 1	2/10/2014	4031005	nd	nd	nd	nd	none
Girls 2	2/10/2014	4031005	nd	nd	nd	nd	none
Hall Gym	2/10/2014	4031005	nd	nd	nd	nd	none
Hall Gym H	2/10/2014	4031005	nd	nd	nd	nd	none
Hall 112 L	2/10/2014	4031005	nd	nd	nd	nd	none
Hall 112 H	2/10/2014	4031005	nd	nd	nd	nd	none
Cafeteria L	2/10/2014	4031005	nd	nd	nd	nd	none
Cafeteria H	2/10/2014	4031005	nd	nd	nd	nd	none
Hall 182 L	2/10/2014	4031005	nd	nd	nd	nd	none
Hall 182 H	2/10/2014	4031005	nd	nd	nd	nd	none
Hall 205 H	2/10/2014	4031005	nd	nd	nd	nd	none
Hall 205 L	2/10/2014	4031005	nd	nd	nd	nd	none
Hall Lib H	2/10/2014	4031005	nd	nd	0.0090	nd	none
Hall Lib L	2/10/2014	4031005	nd	nd	nd	nd	none
Hall 234 H	2/10/2014	4031005	nd	nd	nd	nd	none
Hall 234 L	2/10/2014	4031005	nd	nd	nd	nd	none
Kitchen 1	2/10/2014	4031005	nd	nd	nd	nd	none
Kitchen 2	2/10/2014	4031005	0.0030	nd	nd	nd	none

ND - NONE DETECTED

ITEMS IN RED ARE OVER THE 20 PPB EPA RECOMMENDATION FOR REPLACEMENT

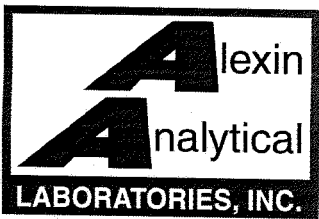

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-01	RRGYM1AS	1/22/14 7:00						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-02	RRGYM1BS	1/22/14 7:02						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-03	RRGYM2AN	1/22/14 7:03						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-04	RRGYM2BN	1/22/14 7:04						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

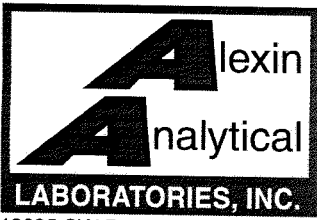

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/22/14 7:06		Sample Composition:				
4031005-05	RRGYM3AUP							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:08		Sample Composition:				
4031005-06	RRGYM3BUP							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:09		Sample Composition:				
4031005-07	RRBOYS1AL							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:11		Sample Composition:				
4031005-08	RRBOYS1BL							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
+Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

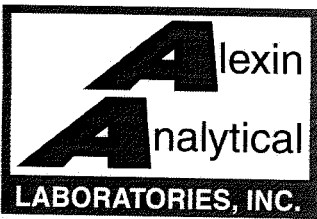

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/22/14 7:12		Sample Composition:				
4031005-09	RRBOYS2AH							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:13		Sample Composition:				
4031005-10	RRBOYS2BH							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:14		Sample Composition:				
4031005-11	RRgirls1AL							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:17		Sample Composition:				
4031005-12	RRgirls1BL							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

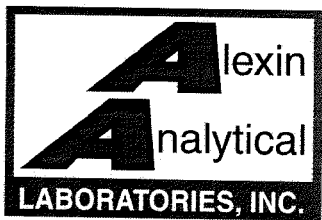

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/22/14 7:18		Sample Composition:				
4031005-13	RRgirls2AH							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:19		Sample Composition:				
4031005-14	RRgirls2BH							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:20		Sample Composition:				
4031005-15	RRHALLGYMLA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:22		Sample Composition:				
4031005-16	RRHALLGYMLB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

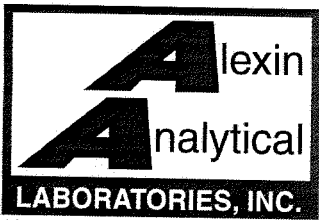

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-17	RRHALLGYMHA	1/22/14 7:23						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-18	RRHALLGYMHB	1/22/14 7:24						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-19	RRHALL112LA	1/22/14 7:27						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-20	RRHALL112LB	1/22/14 7:28						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

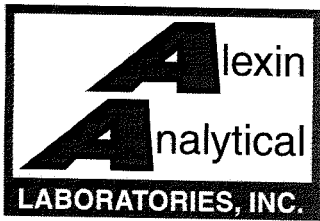

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014

Received: 01/31/2014

Sampled By:

Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/22/14 7:30		Sample Composition:				
4031005-21	RRHALL112HA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:31		Sample Composition:				
4031005-22	RRHALL112HB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:34		Sample Composition:				
4031005-23	RRHALLCAFELA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:35		Sample Composition:				
4031005-24	RRHALLCAFELB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

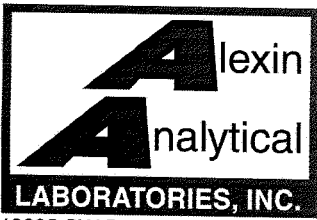

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/22/14 7:36		Sample Composition:				
4031005-25	RRHALLCAFEHA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:37		Sample Composition:				
4031005-26	RRHALLCAFEHB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:44		Sample Composition:				
4031005-27	RRHALL182LA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:49		Sample Composition:				
4031005-28	RRHALL182LB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

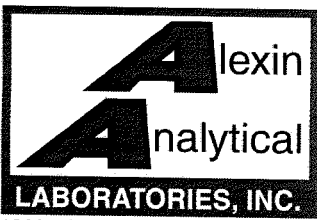

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-29	RRHALL182HA	1/22/14 7:50						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-30	RRHALL182HB	1/22/14 7:51						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-31	RRHALLA205H	1/27/14 6:40						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-32	RRHALLB205H	1/27/14 6:42						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

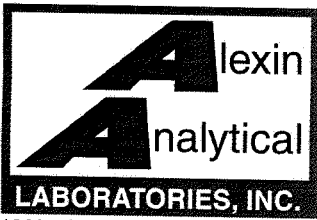

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-33	RRHALLA205L	1/27/14 6:43						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-34	RRHALLB205L	1/27/14 6:45						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-35	RRHALLALIBH	1/27/14 6:47						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled:	Sample Composition:					
4031005-36	RRHALLBLIBH	1/27/14 6:48						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.009	0.002	0.015	-	02/05/14 14:36

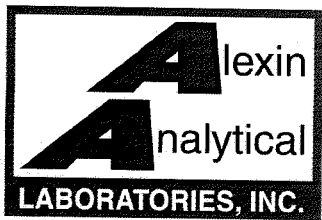

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/27/14 6:49		Sample Composition:				
4031005-37	RRHALLALIBL							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/27/14 6:51		Sample Composition:				
4031005-38	RRHALLBLIBL							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/27/14 6:53		Sample Composition:				
4031005-39	RRHALLA234H							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/27/14 6:54		Sample Composition:				
4031005-40	RRHALLB234H							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

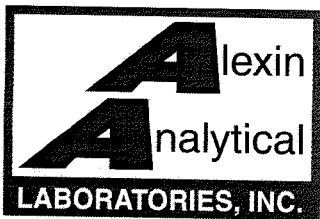

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/27/14 6:55		Sample Composition:				
4031005-41	RRHALLA234L							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/27/14 6:57		Sample Composition:				
4031005-42	RRHALLB234L							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/05/14 14:36

Lab Number	Sample Name	Sampled: 1/22/14 7:55		Sample Composition:				
4031005-43	RRKITCHEN1AE							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

Lab Number	Sample Name	Sampled: 1/22/14 7:56		Sample Composition:				
4031005-44	RRKITCHEN1BE							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/07/14 13:38

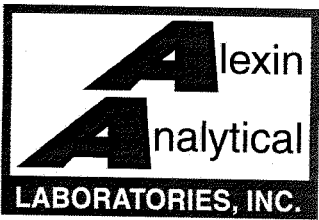

Professional Laboratory Services

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/10/2014
Received: 01/31/2014
Sampled By:
Work Order: 4031005

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141765

Sampling Location: Ron Russell
Sample Matrix: Drinking Water

Table with 9 columns: Lab Number, Sample Name, Sampled, Sample Composition, Metals (Total), Code, Method, Units, Result, MRL, EPA MCL, Secondary Standard*, Analysis Date/ Time. Row 1: 4031005-45, RRKITCHEN2AW, 1/22/14 7:58, Lead 0.003 mg/L.

Table with 9 columns: Lab Number, Sample Name, Sampled, Sample Composition, Metals (Total), Code, Method, Units, Result, MRL, EPA MCL, Secondary Standard*, Analysis Date/ Time. Row 1: 4031005-46, RRKITCHEN2BW, 1/22/14 7:59, ND.

ND = None detected MRL = Minimum Reporting Limit MCL = Maximum Contamination Limit
†All procedures for this analysis conform to NELAC standards.

Approved by: [Signature]
Scott Dickman
Lab Director