

**DAVID DOUGLAS SCHOOL DISTRICT
LEAD TESTING RESULTS BY SCHOOL**

6/6/2016 3:59 PM

Classroom/Location	Analysis Report Date	Work Order #	1st Draw	1 Min Draw	Action Taken
			Test #1 mg/L	Test #2 mg/L	
VENTURA PARK ELEMENTARY SCHOOL					
1	1/9/2014	3364013	0.0150	0.0240	Turned off
2	1/9/2014	3364013	0.0400	0.0350	Turned off
3	1/9/2014	3364013	0.0420	0.0050	Turned off
4	1/9/2014	3364013	0.0250	0.0110	Turned off
5	1/9/2014	3364013	0.0300	0.0070	Turned off
6	1/9/2014	3364013	0.0410	0.0320	Turned off
7	1/9/2014	3364013	0.0200	0.0150	Turned off
8	1/9/2014	3364013	0.0030	0.0060	none
9	1/9/2014	3364013	0.0540	0.0490	Turned off
10	1/9/2014	3364013	0.0260	0.0170	Turned off
11	1/9/2014	3364013	0.0180	0.0040	Turned off
12	1/9/2014	3364013	nd	nd	none
13	1/9/2014	3364013	0.0070	nd	none
14	1/9/2014	3364013	0.0050	nd	none
15	1/9/2014	3364013	0.0040	nd	none
16	1/9/2014	3364013	nd	nd	none
17	1/9/2014	3364013	nd	nd	none
18	1/9/2014	3364013	nd	nd	none
19	1/9/2014	3364013	nd	nd	none
20	1/9/2014	3364013	nd	nd	none
21	1/9/2014	3364013	nd	nd	none
Hall 6	1/9/2014	3364013	0.0160	0.0150	Turned off
Hall 2	1/9/2014	3364013	0.0250	0.0330	Turned off
Ramp 1	1/9/2014	3364013	0.0110	0.0060	none
Ramp 2	1/9/2014	3364013	0.0030	0.0020	none
Hall 10	1/9/2014	3364013	0.0440	0.0700	Turned off
Hall 17	1/9/2014	3364013	nd	nd	none
Office 1	1/9/2014	3364013	0.0240	0.0060	Turned off
Office 2	1/9/2014	3364013	0.0030	nd	none
Library	1/9/2014	3364013	nd	nd	none
Kitchen 1	1/9/2014	3364013	0.0250	nd	Turned off
Kitchen 2	1/9/2014	3364013	0.0185	0.0080	Turned off
Gym	1/9/2014	3364013	0.0220	0.0030	Turned off
Cafeteria	1/9/2014	3364013	nd	nd	none
Lobby	1/9/2014	3364013	0.0330	0.0100	Turned off
Speech	1/9/2014	3364013	0.0550	nd	Turned off
25	1/9/2014	3364013	nd	nd	none
24	1/9/2014	3364013	nd	nd	none
Hall 25	1/9/2014	3364013	nd	nd	none
Hall 24	1/9/2014	3364013	nd	nd	none
Sensory	1/9/2014	3364013	nd	nd	none
OSNW	1/22/2014	4015008	0.0550	0.0110	Outside faucet
Boiler	1/22/2014	4015008	0.0040	nd	none
Ventura Elementary had bottled water starting in spring 2014. School repiped summer 2015.					
Retesting:					
Hall 6	2/20/2014	4044019	nd	nd	Retest ok
8	2/20/2014	4044019	0.0380	0.0370	Retest still high/continue off
Main CW	9/16/2015	5251023	0.0260	n/a	Retest still high - replace vault to bldg
DF - 1 West	9/16/2015	5251023	0.0040	n/a	Retest ok after pipe replacement
8	12/15/2015	5343006	nd	n/a	Retest ok after pipe replacement
25	12/15/2015	5343006	nd	n/a	Retest ok after pipe replacement
Main CW	12/15/2015	5343006	0.0160	n/a	Retest ok after vault to bldg redone
School will be retested during summer of 2016. Water is on at building.					

ND - NONE DETECTED

ITEMS IN RED ARE OVER THE 20 PPB EPA RECOMMENDATION FOR REPLACEMENT



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 9:02		Sample Composition:				
3364013-01	VP1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.015	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 9:04		Sample Composition:				
3364013-02	VP1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.024	0.002	0.015	-	01/03/14 15:08 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 9:12		Sample Composition:				
3364013-03	VP2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.040	0.004	0.015	-	01/03/14 15:08 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 9:13		Sample Composition:				
3364013-04	VP2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.035	0.002	0.015	-	01/03/14 15:08 MCLE

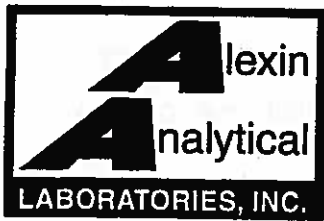

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 9:18		Sample Composition:				
3364013-05	VP3A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.042	0.004	0.015	-	01/03/14 15:08 MCL

Lab Number	Sample Name	Sampled: 12/26/13 9:19		Sample Composition:				
3364013-06	VP3B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 9:21		Sample Composition:				
3364013-07	VP4A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.025	0.002	0.015	-	01/03/14 15:08 MCL

Lab Number	Sample Name	Sampled: 12/26/13 9:22		Sample Composition:				
3364013-08	VP4B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.011	0.002	0.015	-	01/07/14 16:46

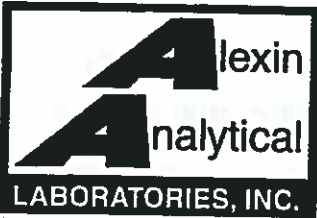

**Professional
Laboratory
Services**

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 9:23		Sample Composition:				
3364013-09	VP5A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.030	0.002	0.015	-	01/03/14 15:08 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 9:24		Sample Composition:				
3364013-10	VP5B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 9:29		Sample Composition:				
3364013-11	VP6A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.041	0.004	0.015	-	01/03/14 15:08 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 9:30		Sample Composition:				
3364013-12	VP6B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.032	0.002	0.015	-	01/03/14 15:08 MCLE

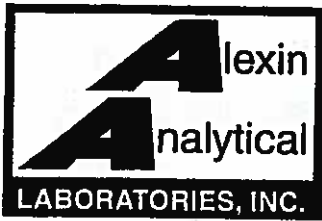

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141528

Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 9:32		Sample Composition:				
3364013-13	VP7A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.020	0.002	0.015	-	01/03/14 15:08 MCL

Lab Number	Sample Name	Sampled: 12/26/13 9:33		Sample Composition:				
3364013-14	VP7B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.015	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 9:35		Sample Composition:				
3364013-15	VP8A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 9:36		Sample Composition:				
3364013-16	VP8B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	01/03/14 15:08



**Professional
Laboratory
Services**

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 9:47		Sample Composition:				
3364013-17	VP9A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.054	0.004	0.015	-	01/03/14 15:08 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 9:48		Sample Composition:				
3364013-18	VP9B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.049	0.004	0.015	-	01/03/14 15:08 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 9:50		Sample Composition:				
3364013-19	VP10A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.026	0.002	0.015	-	01/03/14 15:08 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 9:51		Sample Composition:				
3364013-20	VP10B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.017	0.002	0.015	-	01/03/14 15:08 MCLE

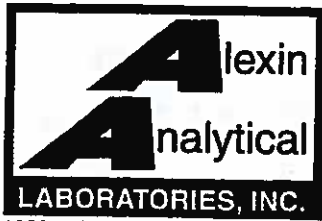

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 9:57		Sample Composition:				
3364013-21	VP11A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.018	0.002	0.015	-	01/03/14 15:08 MCL

Lab Number	Sample Name	Sampled: 12/26/13 9:58		Sample Composition:				
3364013-22	VP11B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:16		Sample Composition:				
3364013-23	VP12A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 10:17		Sample Composition:				
3364013-24	VP12B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

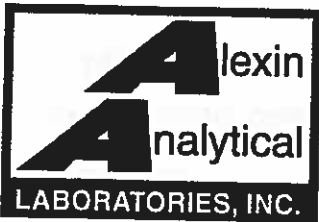

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 10:20		Sample Composition:				
3364013-25	VP13A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.007	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:21		Sample Composition:				
3364013-26	VP13B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:24		Sample Composition:				
3364013-27	VP14A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.005	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 10:25		Sample Composition:				
3364013-28	VP14B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

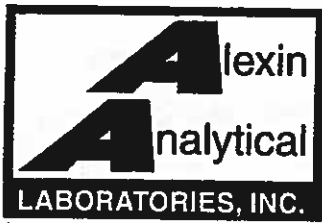

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 10:26		Sample Composition:				
3364013-29	VP15A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:27		Sample Composition:				
3364013-30	VP15B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:36		Sample Composition:				
3364013-31	VP16A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:37		Sample Composition:				
3364013-32	VP16B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

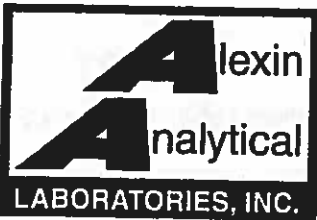

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 10:42		Sample Composition:				
3364013-33	VP17A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 10:43		Sample Composition:				
3364013-34	VP17B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:46		Sample Composition:				
3364013-35	VP18A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 10:47		Sample Composition:				
3364013-36	VP18B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

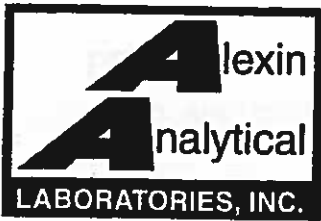

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528

Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 10:49		Sample Composition:				
3364013-37	VP19A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:50		Sample Composition:				
3364013-38	VP19B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:51		Sample Composition:				
3364013-39	VP20A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 10:52		Sample Composition:				
3364013-40	VP20B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08



**Professional
Laboratory
Services**

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 10:56		Sample Composition:				
3364013-41	VP21A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:57		Sample Composition:				
3364013-42	VP21B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 9:27		Sample Composition:				
3364013-43	VPHALL6A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.016	0.002	0.015	-	01/03/14 15:08 MCL

Lab Number	Sample Name	Sampled: 12/26/13 9:28		Sample Composition:				
3364013-44	VPHALL6B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.015	0.002	0.015	-	01/03/14 15:08

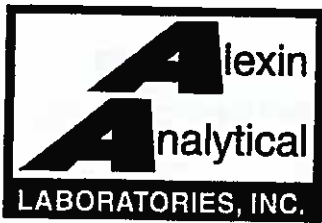

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141528

Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 9:15		Sample Composition:				
3364013-45	VPHALL2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.025	0.002	0.015	-	01/03/14 15:08 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 9:16		Sample Composition:				
3364013-46	VPHALL2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.033	0.002	0.015	-	01/03/14 15:08 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 9:39		Sample Composition:				
3364013-47	VPRAMP1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.011	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 9:40		Sample Composition:				
3364013-48	VPRAMP1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	01/03/14 15:08



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 9:40		Sample Composition:				
3364013-49	VPRAMP2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 9:41		Sample Composition:				
3364013-50	VPRAMP2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.002	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 9:55		Sample Composition:				
3364013-51	VPHALL10A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.044	0.004	0.015	-	01/03/14 15:08 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 9:56		Sample Composition:				
3364013-52	VPHALL10B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.070	0.004	0.015	-	01/03/14 15:08 MCLE

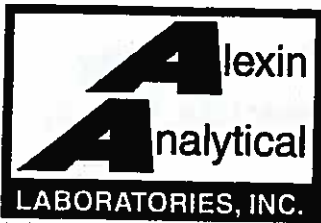

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 10:40		Sample Composition:				
3364013-53	VPHALL17A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 10:41		Sample Composition:				
3364013-54	VPHALL17B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 8:56		Sample Composition:				
3364013-55	VPOFFICE1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.024	0.002	0.015	-	01/03/14 15:08 MCL

Lab Number	Sample Name	Sampled: 12/26/13 8:57		Sample Composition:				
3364013-56	VPOFFICE1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.006	0.002	0.015	-	01/03/14 15:08

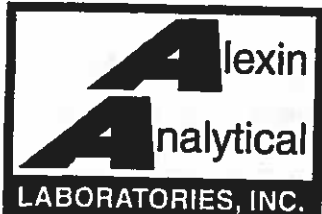

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 8:57		Sample Composition:				
3364013-57	VPOFFICE2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 8:59		Sample Composition:				
3364013-58	VPOFFICE2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 8:52		Sample Composition:				
3364013-59	VPLIBRARYA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 8:53		Sample Composition:				
3364013-60	VPLIBRARYB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

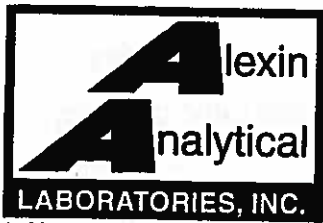

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141528

Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 8:05		Sample Composition:				
3364013-61	VPKITCHEN1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.025	0.002	0.015	-	01/03/14 15:08 MCL

Lab Number	Sample Name	Sampled: 12/26/13 8:07		Sample Composition:				
3364013-62	VPKITCHEN1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/03/14 15:08

Lab Number	Sample Name	Sampled: 12/26/13 8:06		Sample Composition:				
3364013-63	VPKITCHEN2A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.185	0.020	0.015	-	01/07/14 16:46 MCL

Lab Number	Sample Name	Sampled: 12/26/13 8:08		Sample Composition:				
3364013-64	VPKITCHEN2B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	01/07/14 16:46



**Professional
Laboratory
Services**

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 8:12		Sample Composition:				
3364013-65	VPGYM1A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.022	0.002	0.015	-	01/07/14 16:46 MCL

Lab Number	Sample Name	Sampled: 12/26/13 8:14		Sample Composition:				
3364013-66	VPGYM1B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	0.003	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 8:15		Sample Composition:				
3364013-67	VPCAFEA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 8:16		Sample Composition:				
3364013-68	VPCAFEB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

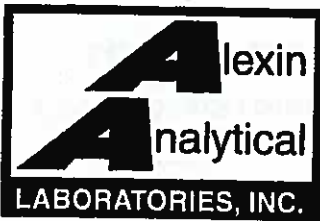

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 8:19		Sample Composition:				
3364013-69	VPLOBBYA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.033	0.002	0.015	-	01/07/14 16:46 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 8:21		Sample Composition:				
3364013-70	VPLOBBYB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.010	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 8:23		Sample Composition:				
3364013-71	VPSPECHA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.055	0.004	0.015	-	01/07/14 16:46 MCLE

Lab Number	Sample Name	Sampled: 12/26/13 8:25		Sample Composition:				
3364013-72	VPSPECHB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

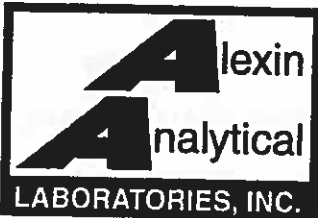

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 839-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project #: N/A
PWSID #: -
PO #: 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 8:29		Sample Composition:				
3364013-73	VP25A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 8:31		Sample Composition:				
3364013-74	VP25B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 8:32		Sample Composition:				
3364013-75	VP24A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 8:34		Sample Composition:				
3364013-76	VP24B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

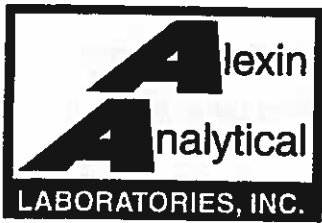

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 839-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141528


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 12/26/13 8:37		Sample Composition:				
3364013-77	VPHALL25A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 8:38		Sample Composition:				
3364013-78	VPHALL25B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 8:42		Sample Composition:				
3364013-79	VPHALL24A							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 8:43		Sample Composition:				
3364013-80	VPHALL24B							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

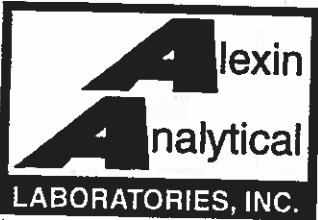

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 01/09/2014
Received: 12/30/2013
Sampled By: Faye Bayer
Work Order: 3364013

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T


Project: -
Project #: N/A
PWSID #: -
PO #: 141528

Sampling Location: Ventura Park
Sample Matrix: Drinking Water


Lab Number	Sample Name	Sampled: 12/26/13 8:50		Sample Composition:				
3364013-81	VPSENSORYA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

Lab Number	Sample Name	Sampled: 12/26/13 8:51		Sample Composition:				
3364013-82	VPSENSORYB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
[†] Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/07/14 16:46

ND = None detected MRL = Minimum Reporting Limit MCL = Maximum Contamination Limit
 MCLE This analyte exceeds the MCL limit.
 †All procedures for this analysis conform to NELAC standards.

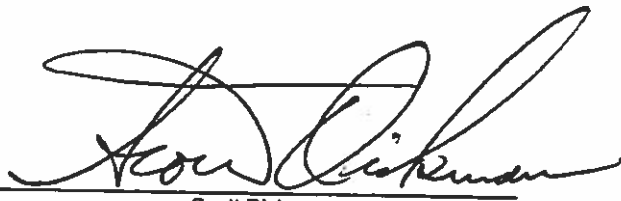Approved by: 
 Scott Dickman
 Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.

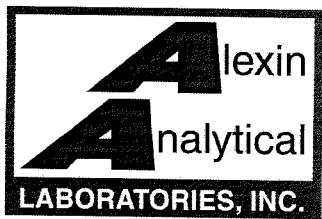

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/20/2014
Received: 02/13/2014
Sampled By: Faye Bayer
Work Order: 4044019

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141935


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled:	Sample Composition:					
4044019-01	RVPHALL6A	2/13/14 7:01						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/19/14 16:42

Lab Number	Sample Name	Sampled:	Sample Composition:					
4044019-02	RVPHALL6B	2/13/14 7:03						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/19/14 16:42

Lab Number	Sample Name	Sampled:	Sample Composition:					
4044019-03	RVPHALL6C	2/13/14 7:08						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	02/19/14 16:42

Lab Number	Sample Name	Sampled:	Sample Composition:					
4044019-04	RVP8A	2/13/14 7:10						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.038	0.002	0.015	-	02/19/14 16:42 MCLE

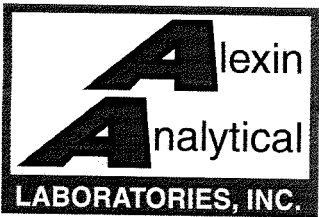

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/20/2014
Received: 02/13/2014
Sampled By: Faye Bayer
Work Order: 4044019

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141935

Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number 4044019-05 **Sample Name** RVP8B **Sampled:** 2/13/14 7:11 **Sample Composition:**


Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.037	0.002	0.015	-	02/19/14 16:42 MCLE

Lab Number 4044019-06 **Sample Name** RVP8C **Sampled:** 2/13/14 7:16 **Sample Composition:**

Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.008	0.002	0.015	-	02/19/14 16:42


ND = None detected **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit
MCLE This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

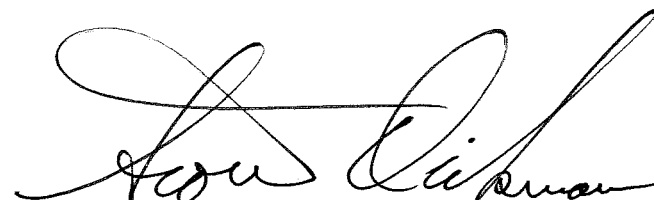Approved by: 

Scott Dickman
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.

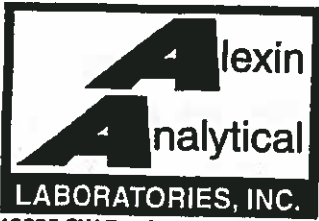

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014

Received: 01/15/2014

Sampled By:

Work Order: 4015008

C David Douglas School District
L Attn: David Callaway
I 2900 SE 122nd
E Portland OR, 97236
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -
PO # : 141765


Sampling Location: Ventura Park
Sample Matrix: Drinking Water

Lab Number	Sample Name	Sampled: 1/14/14 8:01		Sample Composition:				
4015008-01	VPOSNWA <i>outside faucet</i>							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.055	0.004	0.015	-	01/22/14 11:25 MCLE

Lab Number	Sample Name	Sampled: 1/14/14 8:02		Sample Composition:				
4015008-02	VPOSNWB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.011	0.002	0.015	-	01/17/14 14:03

Lab Number	Sample Name	Sampled: 1/14/14 7:55		Sample Composition:				
4015008-03	VPBOILERA							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	01/17/14 14:03

Lab Number	Sample Name	Sampled: 1/14/14 7:56		Sample Composition:				
4015008-04	VPBOILERB							
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	01/17/14 14:03

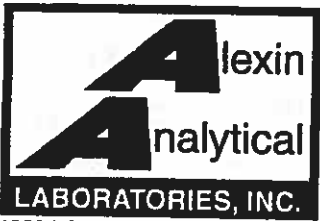

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/22/2014

Received: 01/15/2014

Sampled By:

Work Order: 4015008

C
L
I
E
N
T

David Douglas School District

Attn: David Callaway

2900 SE 122nd

Portland OR, 97236

Phone: (503) 252-2900

Project: -

Project # : N/A

PWSID # : -

PO # : 141765

Sampling Location: Ventura Park

Sample Matrix: Drinking Water

ND = None detected **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit


MCLE This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

Approved by:

Scott Dickman
Lab Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.

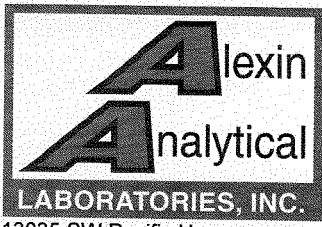

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 09/16/2015
Received: 09/08/2015
Sampled By: Max Roccoforte
Work Order: 5251023

C David Douglas School District
L Attn: -
I 11300 NE Halsey St
E Portland OR, 97220
N Phone: (503) 252-2900
T

Project: -
Project # : N/A
PWSID # : -

Sampling Location: Ventura Park
Sample Matrix: Water

Lab Number	Sample Name	Sampled:	Sample Composition:					
5251023-01	Bubbler @ Rm 8	9/8/15 7:12						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	-	09/15/15 16:32

Lab Number	Sample Name	Sampled:	Sample Composition:					
5251023-02	Main CW	9/8/15 7:00						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.026	0.002	0.015	-	09/15/15 16:32 MCLE

Lab Number	Sample Name	Sampled:	Sample Composition:					
5251023-03	DF-1 (West)	9/8/15 7:15						
Metals (Total)	Code	Method	Units	Result	MRL	EPA MCL	Secondary Standard*	Analysis Date/ Time
†Lead	1030	EPA 200.9	mg/L	0.004	0.002	0.015	-	09/15/15 16:32


ND = None detected **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit
MCLE This analyte exceeds the MCL limit.

†All procedures for this analysis conform to NELAC standards.

Approved by: _____

Adriana Gonzalez-Gray
Laboratory Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.

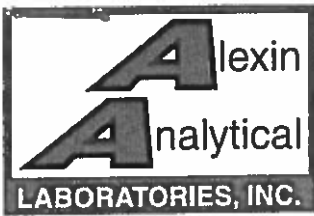

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 12/15/2015
Received: 12/09/2015
Sampled By: Max B. Roccoforte
Work Order: 5343006

C David Douglas School District
L Attn: Max Roccoforte
I 1204 SE 122nd Ave
E Portland OR, 97220
N Phone: (971) 563-1297
T

Project: -
Project # : N/A
PWSID # : -

Sampling Location: Ventura Park Elementry
Sample Matrix: Water

Lab Number

	Code	Method	Units	Result	MRL	EPA MCL	Analysis Date/ Time
5343006-01	Sample Name: Main @ entry Sampled: 12/8/15 7:45						
<i>Metals (Total)</i>							
†Lead	1030	EPA 200.9	mg/L	0.016	0.002	0.015	12/14/15 17:24 MCL
5343006-02	Sample Name: Rm #25 Bubbler Sampled: 12/8/15 7:49						
<i>Metals (Total)</i>							
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	12/14/15 17:24
5343006-03	Sample Name: Rm # 8 Sink Sampled: 12/8/15 7:54						
<i>Metals (Total)</i>							
†Lead	1030	EPA 200.9	mg/L	ND	0.002	0.015	12/14/15 17:24

MCL This analyte exceeds the MCL limit.

ND = None detected at the MRL **MRL** = Minimum Reporting Limit

MCL = Maximum Contamination Limit

†All procedures for this analysis conform to NELAC standards.

Approved by: 
Adriana Gonzalez-Gray
Laboratory Director