

## Radon Inspection Report

**Test Location:**

 19-C080S  
 12900 NE Glisan St  
 Portland, OR 97230

**Test For:**

 David Douglas School District  
 Menlo Park Elementary School

**Inspected By:**

 Danielle Weir  
 12839 NE Airport Way  
 Portland, OR 97230  
 503-421-4813

Bldg. Type: Educational

Type: Diagnosis

## Test Result: Pass

Overall Average:
**0.9 pCi/l**
EPA Average:
**0.9 pCi/l**
**Test Device Details:**

 Serial Number: 238738013  
 Model Number: 1028XP  
 Last Calibration: 02/06/2019  
 Next Calibration: 02/06/2020  
 Cal-Factors: 3.0  
 Motion Error: Yes

**Test Site Condition:**

Mitigation Sys: Installed and Active

**Test Summary:**

<u>CRM Location:</u>	<u>Start:</u>	<u>Stop:</u>	<u>Interval:</u>	<u>Duration:</u>
Gym Office	10/22/2019 09:14 AM	10/25/2019 08:14 AM	1 hr	71 hr
	<u>Min:</u>	<u>Max:</u>	<u>Average:</u>	<u>Measurement Units:</u>
Radon Concentration:	0.0	4.0	0.9	pCi/l

**Comments:**


NRPP 108953 RT



Lic/Cert Signature

Inspection Report Date: 10/25/2019

### Radon Inspection Chart

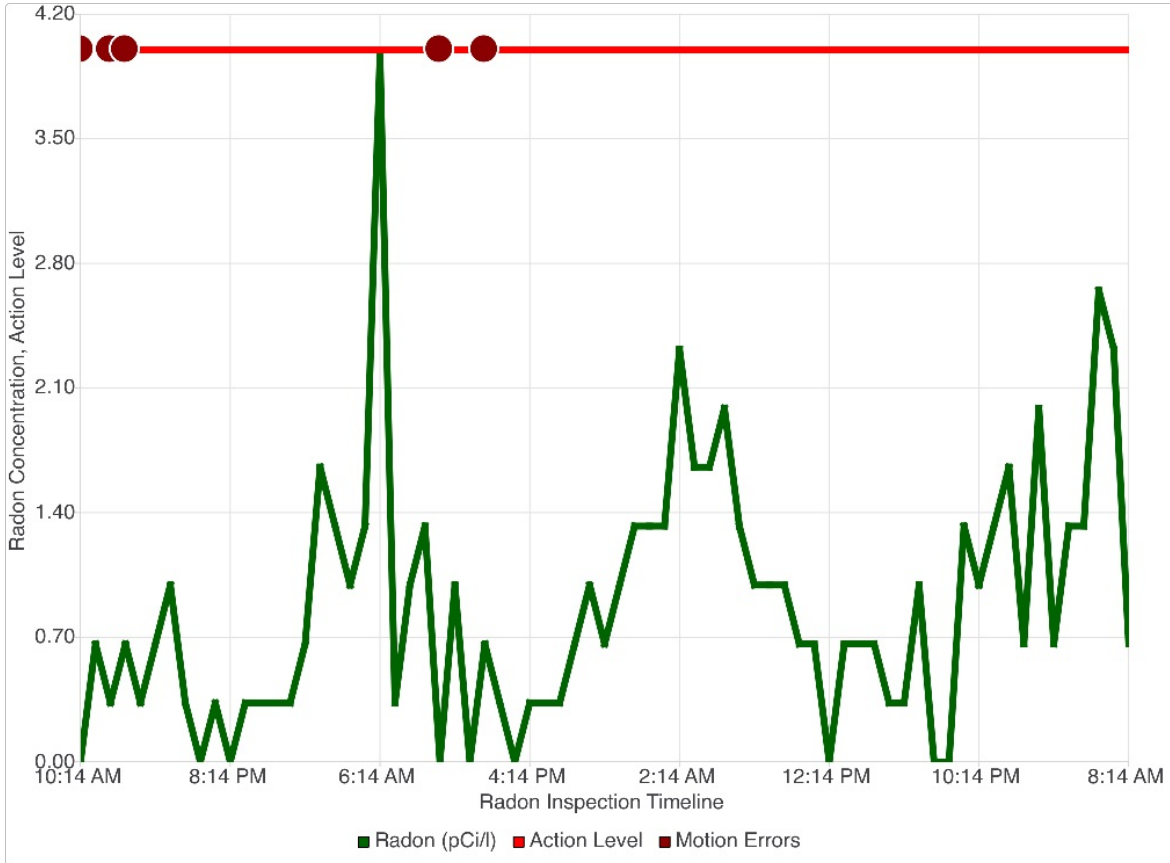

**Test Result: Pass**

**Test Location:** 12900 NE Glisan St Portland, OR 97230

**Inspection Report Date:** 10/25/2019

---

## Test Checklist

---

- The location of the detector was selected so the detector was not to be disturbed during testing.
  
- The monitor was not placed in an area of high humidity such as: Kitchen, laundry room, cellar, spa room, garage, crawl space or sump area.
  
- The detector was not located near drafts caused by HVAC vents, windows and doors.
  
- The detector was not placed near areas of excessive heat, such as a fireplace or in direct sunlight.
  
- The detector was placed within the breathing zone of at least 20 inches to 6 feet above the floor and at least 1 foot below the ceiling if suspended.
  
- The detector was not placed within 1 foot of outside walls of the home or within 3 feet of any windows or doors to the exterior of the home.

---

**Test Result: Pass**

**Test Location:** 12900 NE Glisan St Portland, OR 97230

**Inspection Report Date:** 10/25/2019

---

### Test Table

<u>Date/Time</u>	<u>Radon(pCi/l)</u>	<u>Temp(F)</u>	<u>Pres(inHg)</u>	<u>Humidity(%)</u>	<u>Flags</u>
10/22/19 10:14 AM	0.0	-	-	-	M
10/22/19 11:14 AM	0.7	-	-	-	-
10/22/19 12:14 PM	0.3	-	-	-	M
10/22/19 01:14 PM	0.7	-	-	-	M
10/22/19 02:14 PM	0.3	-	-	-	-
10/22/19 03:14 PM	0.7	-	-	-	-
10/22/19 04:14 PM	1.0	-	-	-	-
10/22/19 05:14 PM	0.3	-	-	-	-
10/22/19 06:14 PM	0.0	-	-	-	-
10/22/19 07:14 PM	0.3	-	-	-	-
10/22/19 08:14 PM	0.0	-	-	-	-
10/22/19 09:14 PM	0.3	-	-	-	-
10/22/19 10:14 PM	0.3	-	-	-	-
10/22/19 11:14 PM	0.3	-	-	-	-
10/23/19 12:14 AM	0.3	-	-	-	-
10/23/19 01:14 AM	0.7	-	-	-	-
10/23/19 02:14 AM	1.7	-	-	-	-
10/23/19 03:14 AM	1.3	-	-	-	-
10/23/19 04:14 AM	1.0	-	-	-	-
10/23/19 05:14 AM	1.3	-	-	-	-
10/23/19 06:14 AM	4.0	-	-	-	-
10/23/19 07:14 AM	0.3	-	-	-	-
10/23/19 08:14 AM	1.0	-	-	-	-
10/23/19 09:14 AM	1.3	-	-	-	-
10/23/19 10:14 AM	0.0	-	-	-	M
10/23/19 11:14 AM	1.0	-	-	-	-
10/23/19 12:14 PM	0.0	-	-	-	-
10/23/19 01:14 PM	0.7	-	-	-	M
10/23/19 02:14 PM	0.3	-	-	-	-
10/23/19 03:14 PM	0.0	-	-	-	-
10/23/19 04:14 PM	0.3	-	-	-	-
10/23/19 05:14 PM	0.3	-	-	-	-
10/23/19 06:14 PM	0.3	-	-	-	-
10/23/19 07:14 PM	0.7	-	-	-	-
10/23/19 08:14 PM	1.0	-	-	-	-
10/23/19 09:14 PM	0.7	-	-	-	-
10/23/19 10:14 PM	1.0	-	-	-	-
10/23/19 11:14 PM	1.3	-	-	-	-
10/24/19 12:14 AM	1.3	-	-	-	-
10/24/19 01:14 AM	1.3	-	-	-	-
10/24/19 02:14 AM	2.3	-	-	-	-
10/24/19 03:14 AM	1.7	-	-	-	-
10/24/19 04:14 AM	1.7	-	-	-	-
10/24/19 05:14 AM	2.0	-	-	-	-

**Test Result: Pass**

**Test Location:** 12900 NE Glisan St Portland, OR 97230

**Inspection Report Date:** 10/25/2019

---

### Test Table

<u>Date/Time</u>	<u>Radon(pCi/l)</u>	<u>Temp(F)</u>	<u>Pres(inHg)</u>	<u>Humidity(%)</u>	<u>Flags</u>
10/24/19 06:14 AM	1.3	-	-	-	-
10/24/19 07:14 AM	1.0	-	-	-	-
10/24/19 08:14 AM	1.0	-	-	-	-
10/24/19 09:14 AM	1.0	-	-	-	-
10/24/19 10:14 AM	0.7	-	-	-	-
10/24/19 11:14 AM	0.7	-	-	-	-
10/24/19 12:14 PM	0.0	-	-	-	-
10/24/19 01:14 PM	0.7	-	-	-	-
10/24/19 02:14 PM	0.7	-	-	-	-
10/24/19 03:14 PM	0.7	-	-	-	-
10/24/19 04:14 PM	0.3	-	-	-	-
10/24/19 05:14 PM	0.3	-	-	-	-
10/24/19 06:14 PM	1.0	-	-	-	-
10/24/19 07:14 PM	0.0	-	-	-	-
10/24/19 08:14 PM	0.0	-	-	-	-
10/24/19 09:14 PM	1.3	-	-	-	-
10/24/19 10:14 PM	1.0	-	-	-	-
10/24/19 11:14 PM	1.3	-	-	-	-
10/25/19 12:14 AM	1.7	-	-	-	-
10/25/19 01:14 AM	0.7	-	-	-	-
10/25/19 02:14 AM	2.0	-	-	-	-
10/25/19 03:14 AM	0.7	-	-	-	-
10/25/19 04:14 AM	1.3	-	-	-	-
10/25/19 05:14 AM	1.3	-	-	-	-
10/25/19 06:14 AM	2.6	-	-	-	-
10/25/19 07:14 AM	2.3	-	-	-	-
10/25/19 08:14 AM	0.7	-	-	-	-

---

**Test Result: Pass**

**Test Location:** 12900 NE Glisan St Portland, OR 97230

**Inspection Report Date:** 10/25/2019

---

---

## Radon Test Information

---

### Radon Risk Information

Radon causes lung cancer by means of the decay of its daughter products after breathing in air contaminated with higher levels of Radon. The World Health Organization (WHO) estimates that 15% of lung cancers worldwide are caused by exposure to elevated indoor levels of Radon. Overall, radon is the second leading cause of lung cancer responsible for about 21,000 lung cancer deaths every year in the US alone. Radon gas is the number one cause of lung cancer among non-smokers. The U.S. Environmental Protection Agency (EPA), the U.S. Surgeon General, and the Center for Disease Control and Prevention (CDC) strongly recommend that ALL homebuyers have an indoor radon test performed prior to purchase or taking occupancy and recommend having the radon levels professionally mitigated if elevated radon concentrations are found.

### Understanding Radon Test Results

Recommended Action Levels vary by country and typically range from 3 pCi/l (100 Bq/m<sup>3</sup>) to 8 pCi/l (300 Bq/m<sup>3</sup>). Recommendations below are based on test results by a Continuous Radon Monitor (CRM) Test of at least 24h duration and are based on recommendations by the EPA.

Measured Average Radon Level:

- At or above 4.0 pCi/l (148 Bq/m<sup>3</sup>): Corrective measures to reduce exposure to radon gas is strongly recommended (ANSI MAH2014)
- Between 2-4 pCi/l (74-148 Bq/m<sup>3</sup>): Consider mitigation or periodic retest as indoor Radon levels vary by season and weather conditions
- Below 2 pCi/l (74 Bq/m<sup>3</sup>): Consider bi-annual retest or whenever significant changes to the home structure or mechanical systems occurred

---

**Test Result: Pass**

**Test Location:** 12900 NE Glisan St Portland, OR 97230

**Inspection Report Date:** 10/25/2019

---