

Radon Inspection Report

Test Location:

 19-C082S
 2921 SE 116th Ave
 Portland, OR 97266

Test For:

 David Douglas School District
 West Powellhurst Elementary School

Inspected By:

 Danielle Weir
 12839 NE Airport Way
 Portland, OR 97230
 5034214813

Bldg. Type: Educational

Type: Diagnosis

Test Result: Pass

Overall Average:
0.5 pCi/l
EPA Average:
0.5 pCi/l
Test Device Details:

 Serial Number: 241996009
 Model Number: 1028XP
 Last Calibration: 07/18/2019
 Next Calibration: 07/18/2020
 Cal-Factors: 2.8
 Motion Error: Yes

Test Site Condition:
Test Summary:

<u>CRM Location:</u>	<u>Start:</u>	<u>Stop:</u>	<u>Interval:</u>	<u>Duration:</u>
Room 14	10/29/2019 08:28 AM	11/01/2019 07:28 AM	1 hr	71 hr

	<u>Min:</u>	<u>Max:</u>	<u>Average:</u>	<u>Measurement Units:</u>
Radon Concentration:	0.0	2.1	0.5	pCi/l
Temperature	32.0	32.0	31.5	F
Humidity	0.0	0.0	0.0	%
Pressure	0.0	0.0	0.0	inHg

Comments:


NRPP 108953 RT Manometer Tunnel:16 Manometer Custodian Room:2.4



Lic/Cert Signature

Inspection Report Date: 11/01/2019

Radon Inspection Chart

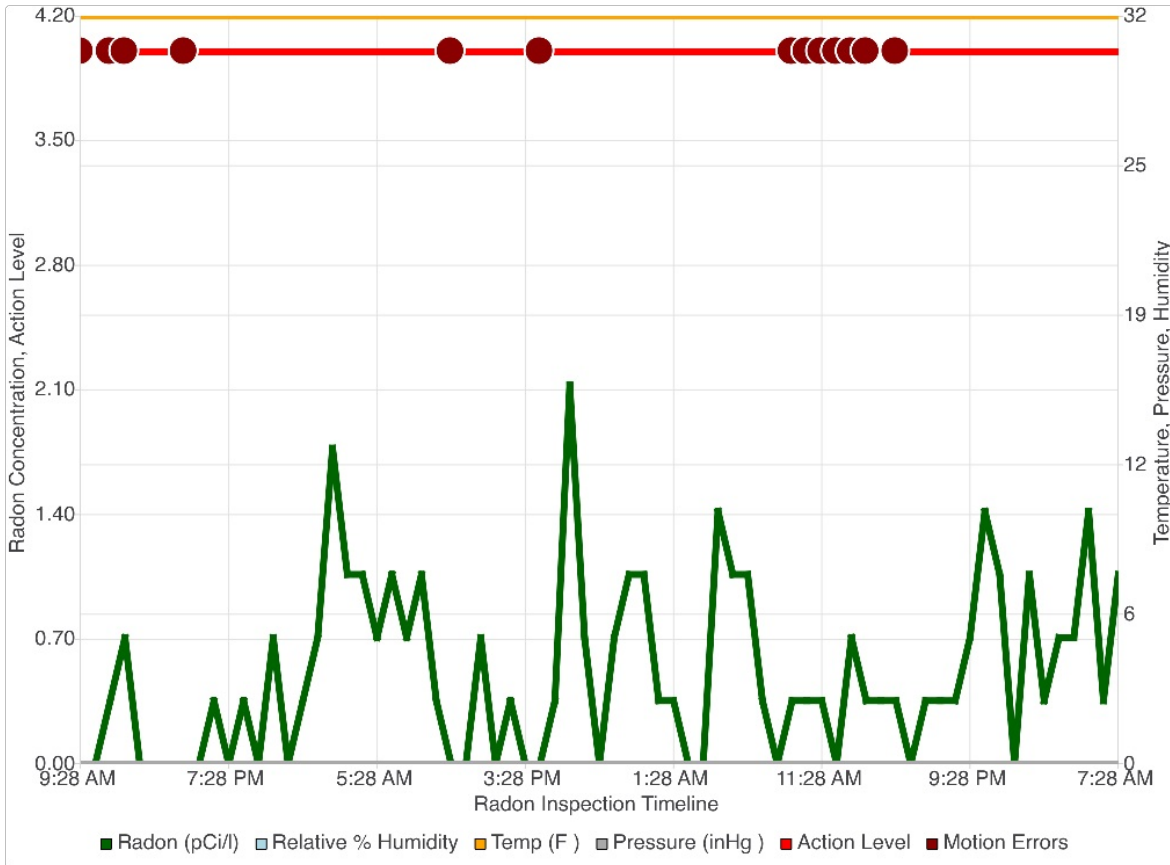

Test Result: Pass

Test Location: 2921 SE 116th Ave Portland , OR 97266

Inspection Report Date: 11/01/2019

Test Checklist

- The monitor was not placed in an area of high humidity such as: Kitchen, laundry room, cellar, spa room, garage, crawl space or sump area.

- The detector was not located near drafts caused by HVAC vents, windows and doors.

- The detector was placed within the breathing zone of at least 20 inches to 6 feet above the floor and at least 1 foot below the ceiling if suspended.

- The detector was not placed within 1 foot of outside walls of the home or within 3 feet of any windows or doors to the exterior of the home.

Test Result: Pass

Test Location: 2921 SE 116th Ave Portland , OR 97266

Inspection Report Date: 11/01/2019

Test Table

Date/Time	Radon(pCi/l)	Temp(F)	Pres(inHg)	Humidity(%)	Flags
10/29/19 09:28 AM	0.0	32.0	0.0	0.0	M
10/29/19 10:28 AM	0.0	32.0	0.0	0.0	-
10/29/19 11:28 AM	0.4	32.0	0.0	0.0	M
10/29/19 12:28 PM	0.7	32.0	0.0	0.0	M
10/29/19 01:28 PM	0.0	32.0	0.0	0.0	-
10/29/19 02:28 PM	0.0	32.0	0.0	0.0	-
10/29/19 03:28 PM	0.0	32.0	0.0	0.0	-
10/29/19 04:28 PM	0.0	32.0	0.0	0.0	M
10/29/19 05:28 PM	0.0	32.0	0.0	0.0	-
10/29/19 06:28 PM	0.4	32.0	0.0	0.0	-
10/29/19 07:28 PM	0.0	32.0	0.0	0.0	-
10/29/19 08:28 PM	0.4	32.0	0.0	0.0	-
10/29/19 09:28 PM	0.0	32.0	0.0	0.0	-
10/29/19 10:28 PM	0.7	32.0	0.0	0.0	-
10/29/19 11:28 PM	0.0	32.0	0.0	0.0	-
10/30/19 12:28 AM	0.4	32.0	0.0	0.0	-
10/30/19 01:28 AM	0.7	32.0	0.0	0.0	-
10/30/19 02:28 AM	1.8	32.0	0.0	0.0	-
10/30/19 03:28 AM	1.1	32.0	0.0	0.0	-
10/30/19 04:28 AM	1.1	32.0	0.0	0.0	-
10/30/19 05:28 AM	0.7	32.0	0.0	0.0	-
10/30/19 06:28 AM	1.1	32.0	0.0	0.0	-
10/30/19 07:28 AM	0.7	32.0	0.0	0.0	-
10/30/19 08:28 AM	1.1	32.0	0.0	0.0	-
10/30/19 09:28 AM	0.4	32.0	0.0	0.0	-
10/30/19 10:28 AM	0.0	32.0	0.0	0.0	M
10/30/19 11:28 AM	0.0	32.0	0.0	0.0	-
10/30/19 12:28 PM	0.7	32.0	0.0	0.0	-
10/30/19 01:28 PM	0.0	32.0	0.0	0.0	-
10/30/19 02:28 PM	0.4	32.0	0.0	0.0	-
10/30/19 03:28 PM	0.0	32.0	0.0	0.0	-
10/30/19 04:28 PM	0.0	32.0	0.0	0.0	M
10/30/19 05:28 PM	0.4	32.0	0.0	0.0	-
10/30/19 06:28 PM	2.1	32.0	0.0	0.0	-
10/30/19 07:28 PM	0.7	32.0	0.0	0.0	-
10/30/19 08:28 PM	0.0	32.0	0.0	0.0	-
10/30/19 09:28 PM	0.7	32.0	0.0	0.0	-
10/30/19 10:28 PM	1.1	32.0	0.0	0.0	-
10/30/19 11:28 PM	1.1	32.0	0.0	0.0	-
10/31/19 12:28 AM	0.4	32.0	0.0	0.0	-
10/31/19 01:28 AM	0.4	32.0	0.0	0.0	-
10/31/19 02:28 AM	0.0	32.0	0.0	0.0	-
10/31/19 03:28 AM	0.0	32.0	0.0	0.0	-
10/31/19 04:28 AM	1.4	32.0	0.0	0.0	-

Test Result: Pass

Test Location: 2921 SE 116th Ave Portland , OR 97266

Inspection Report Date: 11/01/2019

Test Table

<u>Date/Time</u>	<u>Radon(pCi/l)</u>	<u>Temp(F)</u>	<u>Pres(inHg)</u>	<u>Humidity(%)</u>	<u>Flags</u>
10/31/19 05:28 AM	1.1	32.0	0.0	0.0	-
10/31/19 06:28 AM	1.1	32.0	0.0	0.0	-
10/31/19 07:28 AM	0.4	32.0	0.0	0.0	-
10/31/19 08:28 AM	0.0	32.0	0.0	0.0	-
10/31/19 09:28 AM	0.4	32.0	0.0	0.0	M
10/31/19 10:28 AM	0.4	32.0	0.0	0.0	M
10/31/19 11:28 AM	0.4	32.0	0.0	0.0	M
10/31/19 12:28 PM	0.0	32.0	0.0	0.0	M
10/31/19 01:28 PM	0.7	32.0	0.0	0.0	M
10/31/19 02:28 PM	0.4	32.0	0.0	0.0	M
10/31/19 03:28 PM	0.4	32.0	0.0	0.0	-
10/31/19 04:28 PM	0.4	32.0	0.0	0.0	M
10/31/19 05:28 PM	0.0	32.0	0.0	0.0	-
10/31/19 06:28 PM	0.4	32.0	0.0	0.0	-
10/31/19 07:28 PM	0.4	32.0	0.0	0.0	-
10/31/19 08:28 PM	0.4	32.0	0.0	0.0	-
10/31/19 09:28 PM	0.7	32.0	0.0	0.0	-
10/31/19 10:28 PM	1.4	32.0	0.0	0.0	-
10/31/19 11:28 PM	1.1	32.0	0.0	0.0	-
11/01/19 12:28 AM	0.0	32.0	0.0	0.0	-
11/01/19 01:28 AM	1.1	32.0	0.0	0.0	-
11/01/19 02:28 AM	0.4	32.0	0.0	0.0	-
11/01/19 03:28 AM	0.7	32.0	0.0	0.0	-
11/01/19 04:28 AM	0.7	32.0	0.0	0.0	-
11/01/19 05:28 AM	1.4	32.0	0.0	0.0	-
11/01/19 06:28 AM	0.4	32.0	0.0	0.0	-
11/01/19 07:28 AM	1.1	32.0	0.0	0.0	-

Test Result: Pass

Test Location: 2921 SE 116th Ave Portland , OR 97266

Inspection Report Date: 11/01/2019

Radon Test Information

Radon Risk Information

Radon causes lung cancer by means of the decay of its daughter products after breathing in air contaminated with higher levels of Radon. The World Health Organization (WHO) estimates that 15% of lung cancers worldwide are caused by exposure to elevated indoor levels of Radon. Overall, radon is the second leading cause of lung cancer responsible for about 21,000 lung cancer deaths every year in the US alone. Radon gas is the number one cause of lung cancer among non-smokers. The U.S. Environmental Protection Agency (EPA), the U.S. Surgeon General, and the Center for Disease Control and Prevention (CDC) strongly recommend that ALL homebuyers have an indoor radon test performed prior to purchase or taking occupancy and recommend having the radon levels professionally mitigated if elevated radon concentrations are found.

Understanding Radon Test Results

Recommended Action Levels vary by country and typically range from 3 pCi/l (100 Bq/m³) to 8 pCi/l (300 Bq/m³). Recommendations below are based on test results by a Continuous Radon Monitor (CRM) Test of at least 24h duration and are based on recommendations by the EPA.

Measured Average Radon Level:

- At or above 4.0 pCi/l (148 Bq/m³): Corrective measures to reduce exposure to radon gas is strongly recommended (ANSI MAH2014)
- Between 2-4 pCi/l (74-148 Bq/m³): Consider mitigation or periodic retest as indoor Radon levels vary by season and weather conditions
- Below 2 pCi/l (74 Bq/m³): Consider bi-annual retest or whenever significant changes to the home structure or mechanical systems occurred

Test Result: Pass

Test Location: 2921 SE 116th Ave Portland , OR 97266

Inspection Report Date: 11/01/2019
